

Construction Specification 000 IA CS-00-1 Site Preparation

1. SCOPE

Site preparation work shall consist of clearing, grubbing, stripping, refuse removal, bank sloping and structure removal on the site as necessary to rid the site of all undesirable materials on or near the surface and prepare the site for the structure. All woody growth within the construction area shall be cleared and all stumps and roots one inch in diameter or larger shall be grubbed from the site. In addition, all areas within 25 feet of the footprint of the structure shall be cleared and grubbed except as directed by NRCS. The work shall also consist of the removal and disposal of structures (including fences) that must be removed to perform other items of work.

For wetland restoration, enhancement, or creation projects, the wetland area shall be disturbed as little as possible and existing naturally vegetated spillway areas shall not be disturbed.

2. FOUNDATION PREPARATION

The construction areas shall be stripped a minimum of 6 inches to remove all unsuitable materials such as organic matter, grasses, weeds, sod, debris, and stones larger than 6 inches in diameter.

In an earth embankment foundation area, all channel banks and sharp breaks shall be sloped to no steeper than 1.5 horizontal to 1 vertical.

The foundation area shall be thoroughly scarified before placement of fill material. The surface shall have moisture added or shall be compacted if necessary so that the first layer of fill material can be compacted and bonded to the foundation.

3. STRIPPED MATERIAL DISPOSAL

Suitable soil material shall be stockpiled for use as topsoil. The other stripped materials shall be buried, removed from the site, or disposed of as directed by the owner or NRCS. Whenever possible, material shall not be disposed of in the pool area created by the structure.

Stockpiled materials around a construction site should be placed so as not to hinder subsequent construction operations.

4. DISPOSAL OF REFUSE MATERIALS

Waste materials from clearing and structure removal shall be burned or buried at locations approved by the owner. Buried materials shall be covered with a minimum of 2 feet of earthfill. Whenever possible, material shall not be disposed of in any pool area created by the structure.

All refuse shall be disposed of in a manner which complies with all local and state regulations.

5. SALVAGE

Items to be salvaged shall be as shown on the drawings. Structures and fencing materials that are designated to be salvaged shall be carefully removed and neatly placed in the specified storage areas.

6. SPECIFIC SITE REQUIREMENTS

A. Measurement and Payment

Compensation for any work item described in the contract documents but not listed in the bid schedule will be included in the payment for the item of work to which it is made subsidiary. Such items and bid items to which they are made subsidiary are identified in Items of Work and Construction Details section of this specification.

For items of work which lump sum prices are established in the contract, the quantity of work will not be measured for payment. Payment for each item will be made at the contract lump sum price and will constitute full compensation for completion of the work.

For items of work for which specific unit prices are established in the contract, the payment will be made based on the approved quantity measured by the engineer or weight tickets. Payment will constitute full compensation of the work completed as defined by each work item.

B. Items of Work and Construction Details

1. Bid Item No.	53
-----------------	----

This item consists of crop damage that results from construction activities. It is recommended contractor remove corn residue rather than knock it down.

Payment for crop damage will be made to the nearest 0.1 acre as measured by the Engineer or their representative. The unit rate for crop damage will be determined by the Division near the completion of construction and added to the contract with a Change Order. Payment will be made to contractor who will pay landowner.

2. Topsoil stripping is subsidiary to Bid Item No. 9 Topsoil Stripping

Construction Specification

000 IA CS-005 Pollution Control 2011

1. SCOPE

The work shall consist of installing measures or performing work to control erosion and minimize the production of sediment and other pollutants to water and air during construction operations.

2. MATERIALS

All materials furnished shall meet the requirements shown on the drawings or in the specifications.

3. EROSION AND SEDIMENT CONTROL MEASURES AND WORKS

The measures and works shall include, but are not limited to, the following:

Staging of Earthwork Activities: The excavation and moving of soil materials shall be scheduled so that areas unprotected from erosion will be minimized. These areas will be unprotected for the shortest time feasible.

Seeding: Structures and disturbed areas shall be seeded as soon as possible after construction is completed.

Temporary seedings may be used as an alternative to other stabilization measures as approved by NRCS.

Mulching: Construction areas that have been disturbed but have no construction activity scheduled for 21 days or more shall have erosion protection measures applied by the 14th day. This erosion protection may be mulching or other approved temporary measures. Construction areas shall not be left open during a winter shutdown period and shall be protected by mulching.

All seeding and mulching shall be completed in accordance with the seeding plan and Iowa Construction Specification IA-6, Seeding and Mulching for Protective Cover.

The following works may be temporary. If they are installed as a temporary measure, they shall be removed and the area restored to its original state when they are no longer needed or when permanent measures are installed.

Diversions: Diversions may be required to divert clean runoff water away from work areas and to collect runoff from work areas for treatment and safe disposition.

Stream Crossings: Culverts or bridges may be required where construction equipment must cross streams.

Sediment Basins: Sediment basins may be required to settle and filter out sediment from eroding areas to protect properties and streams below the construction site.

Sediment Filters: Straw bale filters, geotextile sediment fences, or other equivalent methods may be used to trap sediment from areas of limited runoff. Sediment filters shall be properly anchored to prevent erosion under them.

Waterways: Waterways may be required for the safe removal of runoff from fields, diversions, and other structures or measures

4. CHEMICAL POLLUTION

The Contractor shall provide watertight tanks or barrels or construct a sump sealed with plastic sheets to be used to dispose of chemical pollutants, such as drained lubricating or transmission oils, greases, soaps, concrete mixer wash water, asphalt, etc., produced as a by-product of the construction work.

At the completion of the construction work, sumps shall be removed and the area restored without causing pollution.

Sanitary facilities such as chemical toilets or septic tanks shall not be placed adjacent to live streams, wells, or springs. They shall be located at a distance sufficient to prevent contamination of any water sources. At the completion of construction work, facilities shall be disposed of without causing pollution.

5. AIR POLLUTION

The burning of brush or trash or disposal of other materials shall adhere to local and state regulations.

Fire prevention measures shall be taken to prevent the start or the spreading of wild fires, which result from project work. Fire breaks or guards shall be constructed at locations shown on the drawings.

All public access or haul roads used by the contractor during construction of the project shall be sprinkled or otherwise treated to fully suppress dust. All dust control methods shall insure safe operations at all times. If chemical dust suppressants are used, the material shall be a commercially available product specifically designed for dust suppression and the application shall follow manufacturer's requirements and recommendations. A copy of the product data sheet and manufacturer's recommended application procedures shall be provided to the Engineer five working days before use.

6. MAINTENANCE, REMOVAL, AND RESTORATION

All pollution control measures and works shall be adequately maintained in a functional condition as long as needed during the construction operation. All temporary measures shall be removed and the site restored to as near original conditions as practical.

7. SPECIFIC SITE REQUIREMENTS

A. Measurement and Payment

Compensation for any work item described in the contract documents but not listed in the bid schedule will be included in the payment for the item of work to which it is made subsidiary. Such items and bid items to which they are made subsidiary are identified in Items of Work and Construction Details section of this specification.

For items of work which lump sum prices are established in the contract, the quantity of work will not be measured for payment. Payment for each item will be made at the contract lump sum price and will constitute full compensation for completion of the work.

For items of work for which specific unit prices are established in the contract, the payment will be made based on the approved quantity measured by the engineer or weight tickets. Payment will constitute full compensation of the work completed as defined by each work item.

B. Items of Work and Construction Details

1. Subsidiary Item - Pollution Control

This item shall consist of applying and performing all construction activities in a manner that will minimize water pollution, air pollution and soil erosion.

No separate payment will be made for Pollution Control. Compensation for this item will be other items as appropriate.



Construction Specification
000 IA-6 Seeding and Mulching for Protective Cover

1. SCOPE

The work shall consist of seeding, mulching, and fertilizing all disturbed areas and other areas as indicated on the drawings or otherwise designated.

2. SEEDBED PREPARATION AND APPLICATION

The entire area to be seeded shall be reasonably smooth and all washes and gullies shall be filled to conform to the desired cross-section before actual seedbed preparation is begun. At this stage of the operation, the required fertilizer and lime shall be applied uniformly and incorporated into the top 3 inches of the soil with suitable tillage equipment. The seedbed preparation operation shall be suspended when the soil is too wet or too dry. The seedbed shall be loosened to a depth of at least three inches.

On side slopes steeper than 2-1/2 horizontal to 1 vertical, the 3 inch minimum depth of seedbed preparation is not required, but the soil shall be worked enough to insure sufficient loose soil to provide adequate seed cover.

Unless otherwise specified, the seeding operation shall be performed immediately after preparation of the seedbed. The seed shall be drilled or broadcast by equipment that will insure uniform distribution of the seed.

3. MATERIALS

The seeding, fertilizing, and mulching requirements are as specified on Form IA-CPA-4.

Straw from cereal grains or hay will be used as mulching material. It shall be relatively free of weeds.

4. MULCH APPLICATION

The required mulching shall be performed as soon as possible after seeding unless otherwise specified. The mulch shall be applied uniformly over the area. The type and rate shall be as specified. When mulching is required, all areas seeded during any one day shall be mulched within 24 hours. The mulch may be spread by any means that results in a uniform cover.

The mulch shall be anchored. Anchoring of the mulch may be performed by a mulch anchoring tool or regular farm disk weighted and set nearly straight, by installation of mulch netting, or by other methods approved by NRCS.

Specific Site Requirements

County	Site	Seed Mix
Tama	Site 2	Smooth Brome
	Site 4	Smooth Brome
	Site 5	SUDAS 9010 Native Grass and Forbs (Wildflowers)
	Site 6	Smooth Brome
	Site 8	Smooth Brome
	Site 11	Smooth Brome
Grundy	Site 17	Smooth Brome
	Site 18	Pheasants Forever IA CP42 Wet Prairie Pollinator 20/20 Mix
	Site 21	Smooth Brome
	Site 22	Smooth Brome

H. Native Grass and Forbs (Wildflower) Seeding: Between April 1 and June 30, use the following seed mixture for areas designated for native grass and wildflower seeding.

Table 9010.13: Native Grass and Forbs (Wildflower) Seeding Mixture

Common Name	Scientific Name	Application Rate**
GRASSES		lb/acre
Big bluestem*	Andropogon gerardii	1.0
Canada wild rye	Elymus Canadensis	1.5
Indiangrass*	Sorghastrum nutans	1.0
Little bluestem*	Schizachyrium scorparium	2.0
Sideoats grama*	Boutelouea curtipendula	2.5
Switchgrass*	Panicum virgatum	0.5
FORBS (WILDFLOWERS)		oz/acre
Black-eyed Susan	Rudbeckia hirta	3.0
Butterfly milkweed	Asclepias tuberosa	4.0
Canadian anemone	Anemone canadensis	0.5
Common mountainmint	Pycnanthemum virginianum	0.25
Golden Alexanders	Zizia aurea	8.0
Grey-headed coneflower	Ratibida pinnata	2.75
Heath aster	Symphotrichum ericoides	0.25
Ironweed	Veronia fasciculata	3.0
New England aster	Symphotrichum novae-angliae	1.25
Ohio spiderwort	Tradescantia ohiensis	7.0
Oxeye sunflower	Heliopsis helianthoides	12.0
Pale purple coneflower	Echinacea pallida	15.0
Partridge pea	Chamaecrista fasciculata	32.0
Prairie blazing star	Liatris pycnostachya	4.5
Purple prairie clover	Dalea purpurea	2.5
Rattlesnake master	Eryngium yuccifolium	1.75
Showy goldenrod	Solidago speciosa	0.50
Stiff goldenrod	Solidago rigida	1.0
Swamp milkweed	Asclepias incarnata	4.0
White wild indigo	Baptisia alba	2.0
Wild bergamot	Monarda fistulosa	1.25
NURSE CROP		lb/acre
Oats (spring seeding - April 1 to June 30)		32
Winter wheat (dormant/frost seeding - November 1 to March 31)		25

* Furnish seed certified as Source Identified Class (Yellow Tag) Source G0-Iowa.

** Seeding rates for native grass and forb species are given as PLS. Either the germination test or Tetrazolium (TZ) test is acceptable to determine PLS for native species.

Refer to plans for further details. Measurement and payment shall be to the nearest hundredth of an acre of seeded area. Item includes all labor, equipment, mulch, and fertilizer required to complete the work.



Critical Area Planting

Iowa Implementation Requirements

Natural Resources Conservation Service
Des Moines, Iowa

Iowa Conservation Practice 342
June 2017 revised October 2022

Definition

Establishing permanent vegetation on sites that have or are expected to have high erosion rates, and on sites that have physical, chemical or biological conditions that prevent the establishment of vegetation with normal practices.

Purpose

- Stabilize areas with existing or expected high rates of soil erosion by water and wind.
- Stabilize areas, such as sand dunes and other riparian areas.
- Stabilize stream and channel banks, ponds and other shorelines, and earthen features of structural conservation practices.



Condition Where Practice Applies

This practice applies to highly disturbed areas, such as: active or abandoned mined lands; urban restoration sites; construction areas; conservation practice construction sites; eroded banks of natural and constructed channels and lake shorelines; areas needing stabilization before or after natural disasters, such as floods, hurricanes, tornadoes and wildfires; and other areas degraded by human activities or natural events.

Criteria for Conservation Cover

A. Seeding Periods

Permanent, perennial vegetative cover and/or trees will be established during the first recommended seeding or planting period for the selected species or mixture. Planting dates are outlined on Table 1 of this implementation requirement. Planting immediately after construction of earthen structures such as terraces, grade stabilization, or ponds may be completed at the discretion of the Conservation Planner with Job Approval Authority.

B. Fertilizer and Lime Requirements

No fertilizer requirement for seedings that are predominantly native. Apply 50 lbs per acre of Nitrogen and follow Iowa State University PM-1688 to apply phosphorus, potassium and lime (lime to a minimum target pH of 6.0 at a 3 inch depth) based on a soil test.

When a current soil test is not available, apply 50 lbs P₂O₅ per acre, 50 lbs K₂O per acre and 1000 pounds per acre ECCE lime. Fertilizer requirements may be waived at the discretion of the Conservation Planner with Job Approval Authority on sites:

- Less than 1 acre in size.
- Where application equipment cannot access the site (i.e. steep sides of terraces, grade stabilization, ponds).
- Field practices, such as waterways, when soil tests for adjacent cropland is at optimum or higher.

C. Companion Crop

All critical area plantings will contain a companion crop of spring cereal rye or will be mulched. Mulching is recommended on slopes steeper than 4:1 where mowing of a companion crop may be difficult or dangerous. Mulch of small grain straw shall be used at the rate of 2 tons/ac.

For spring seedings of introduced species, oats or a spring cereal grain shall be seeded at a rate of 1 1/2 bushels/acre to reduce soil erosion and help control weed competition. The oats shall be clipped at the time of seed head emergence to promote growth of the new permanent cover. The use of the companion crop is not required when interseeding.

D. Seedbed preparation and Seeding

1. Conventional seeding for spring and late summer seeding periods where site conditions allow for safe operation of equipment.

- The seedbed shall be worked to a depth of 3", smooth, friable and firm before seeding.
- All tillage operations shall be performed across the general slope of the land.
- Grass and legume seed shall be drilled uniformly over the area at a 1/4-1/2 inch depth or broadcast uniformly over the area and rolled into the seedbed.
- Where erosion is a concern prepare a seedbed with tillage tool that will leave enough residue or provide mulch to provide adequate protection.

2. No-till seeding for spring, late summer and dormant seeding periods where site conditions allow for safe operation of equipment.

- Approved herbicides shall be applied to kill or suppress existing weed competition, as necessary. Herbicides will not be used in waterways or filter strips adjacent to wetlands or other waterbody.
- A drill designed for no-till planting shall be used to plant the seed at a depth of 1/4 - 1/2 inch.

3. Frost Seeding

- Broadcast seed for only those species approved for frost seeding as shown in table 2 and table 3.

4. Hydro-seeding

- Hydro-seeding can be used on all sites but especially on sites that are too steep for regular seeding equipment to operate. The prescribed procedure will be to apply the seed and fertilizer in a water slurry uniformly over the surface. A second trip will be needed to apply an asphalt emulsion to long fiber mulch as it is blown on.

5. Sodding

- All sod used shall be free of noxious weeds as listed in Iowa State Laws and shall be cut from stands giving not less than 90 percent ground cover.
- Only moist, fresh sod shall be used. Lay sod as soon as possible after delivery to the site. Wet soil to a depth of 2 inches or more prior to laying the sod. Lay the sod from the lower end of the slope. Sod strips shall be laid at right angles to the flow of water, stagger joints. Fill any open joints with loose soil. Tamp or roll laid sod to insure a solid contact of root mass to soil surface.
- On severely steep sites or when anticipating overland flow, sod shall be held in place by woven wire, wooden pegs, wire staples, or similar material. Pegs or staples will be a minimum of 10 inches long.

E. Seeding Stand Improvement

This includes any stand modification that maintains some vegetative component of the original stand.

1. Incorporation of grasses and/or legumes with light tillage.

- Weaken the existing stand in the fall or early winter by use of herbicides, grazing, mowing or a combination of these methods.

- Use a disk, cultivator, or similar tool to disturb 40- 50% of the existing stand.
 - Grass and legumes shall be drilled uniformly over the area at 1/4-1/2 inch depth, or broadcast uniformly over the area and rolled into the seedbed.
 - Remove early spring regrowth by mowing to reduce competition and allow the new seedlings to become established.
2. Incorporation of grasses and/or legumes with no- tillage (interseeding) for spring, late summer and dormant seeding periods.
- When interseeding into existing sod, graze, burn, mow or apply herbicides to kill strips or suppress existing vegetation and to control weed competition. Herbicides will not be used in waterways or filter strips adjacent to wetlands or other waterbody.
 - Control broadleaf weeds by applying herbicide at least two weeks prior to applying contact herbicides and prior to seeding.
 - Grass and legumes shall be drilled uniformly over the area at 1/4-1/2 inch depth.
 - Remove early spring regrowth by mowing to reduce competition and allow the new seedlings to become established.
3. Incorporation of grasses and/or legumes with frost seeding.
- Broadcast seed only species approved for frost seeding as shown in table 2 and table 3. Small smooth (shiny) seeded species are best for incorporation into the soil during freezing and thawing.
 - Frost seeding is likely to be more successful if existing stand is weak and less than 50 percent of the ground is covered with live vegetation.

F. Inoculation

1. Legume seed shall be inoculated and the inoculant shall be specific to the legume seeded.
2. When more than one legume species is used, each species shall be inoculated separately.

G. Seed Quality

1. All seed shall be of high quality and comply with Iowa Seed and Weed Laws.
2. Cool season (introduced) grass and legume seeding rates are expressed in bulk pounds/acre. Seed quality shall not drop below 80% Pure Live Seed (PLS) where $PLS = (\% \text{ germination} + \text{dormant seed}) \times \% \text{ purity}$.
3. Native grass species seeding rates are expressed in PLS pounds/acre.

H. Management during the Establishment Year

Plant species and cultivars shall be selected based upon:

1. Climatic conditions such as annual rainfall, seasonal rainfall, growing season length, humidity levels, temperature extremes and the USDA Plant Hardiness Zones.
2. Soil condition and position attributes such as pH, percent slope, available water holding capacity, aspect, drainage class, inherent fertility, flooding and ponding, and levels of salinity and alkalinity.
3. Plant characteristics such as season of growth, vigor, ease of establishment, longevity of the species, growth habit, adaptation to soil conditions, and conservation value.
4. Resistance to diseases and insects common to the site or location.
5. Compatibility with other plant species and their selected cultivars in rate of establishment and growth habit when seeded together as a mixture.
6. Seeding Rates

The pure stand rates in table 2 of this standard are the minimum rates for planting a single species stand into well-prepared seedbed at the proper placement. The pure stand rates are decreased to a percentage of the desired stand when used to calculate a mixture of two or more species. Select combinations of plant species and cultivars best adapted to site conditions.

7. When frost seeding is used, the seeding rate shown in table 2 and table 3 shall be multiplied by 1.5.

8. Introduced Species

- Approved introduced plant species, allowable mixture composition and the pure stand seeding rate are shown in Table 2.
- A designed seeding mixture shall meet criteria specified in table 2 as to species composition and seeding rate.
- For critical area seeding used for erosion control, at least 50% of mixture shall be composed of grasses.
- Tall Fescue shall not compose more than 10% of the mixture if the secondary purpose is for wildlife.
- Mixtures may include up to 20% native grasses. Use the criteria for the predominant species in the mixture for stand establishment.

9. Native Species

- Approved native plant species, allowable mixture composition and a pure stand seeding rate are shown in Table 3.
- A designed seeding mixture shall meet criteria specified in table 3 as to species composition and seeding rate. At least 50% of the mixture shall be composed of grasses. For seeding mixtures with the secondary purpose of wildlife not more than 20% of the mixture will be composed of switchgrass.
- When developing seeding mixtures, except eastern gamma grass, use 60 seeds/sq. ft. for grass stands.
- Mixtures may include up to 20% introduced legumes. Use the criteria for the predominant species in the mixture for stand establishment.

I. Weed Control During the Establishment Year Weed control during the establishment year shall be provided to ensure survival of the new permanent seeding.

1. To manage severe weed competition, native species may be mowed no closer than 8 inches and introduced species no closer than 4 inches.
2. Approved herbicides may be used on both introduced and native plantings to control weed species.

J. Establishment of Temporary Cover

Temporary cover may be required to reduce potential weed and erosion problems where one of the following conditions exists.

1. Fields with herbicide carry over.
2. Where planting is delayed due to unavailability of seed.
3. The normal planting period has passed.
4. Temporary cover or mulching will be established on sites where construction delays or shutdowns occur if the delay or shutdown will last more than 30 days.
5. The temporary cover shall be seeded as specified in Table 4.

K. Site Protection and Access Control

Grazing animal access to planted areas will be controlled for a minimum of two growing seasons during the establishment period.

All areas to be grazed will have a grazing plan that meets the criteria in the Iowa Field Office Technical Guide. Grazing shall be permanently excluded on high hazard areas, such as cut banks, areas of seepage, or other potentially unstable areas.

L. Re-vegetate Degraded Sites that Cannot Be Stabilized Through Normal Farming Practices

If gullies or deep rills are present, they will be filled and leveled as necessary to allow equipment operation and ensure proper site and seedbed preparation.

Based on a soil test and other appropriate site evaluations, soil amendments will be added as necessary to improve or eliminate physical or chemical conditions that inhibit plant establishment and growth.

Table 1. Seeding dates for introduced and native species

Type of Seeding	Introduced Species ² (Grasses and Legumes)	Native Species ³
Spring	March 1 - May 15	April 1 - July 1
Late Summer	August 1 - September 15	Not Recommended
Dormant ¹	November 15 - Freeze	November 15 - Freeze
Frost ¹	February 1 - March 15	February 1 - March 15

1. Refer to Table 2 and 3 for applicable plant species.
2. Includes all species generally considered introduced.
3. Includes all warm and cool season natives planted in mixture.

Table 2. Seeding chart for introduced plant species

Plant Species	% of Mixture (Range Allowed)		Seeding Rate PLS/acre
	Critical Areas Grassland ^{3/}	Trees, Shrubs & Wildlife	
Smooth brome ¹	0-100	0-25	25
Kentucky bluegrass ¹	0-80	0-10	25
Orchardgrass ²	0-25	0-100	10
Timothy ²	0-25	0-100	10
Alfalfa ²	0-50	0-50	20
Red clover ²	0-50	0-50	16
Birdsfoot trefoil ²	0-50	0-25	16
Reed Canarygrass ⁵	0-25	0	16
Perennial rye	0-50	0-50	25
Ladino clover ²	0-50	0-50	8
Red top	0-50	0-80	10
Alsike clover ²	0-50	0-50	8
Tall Fescue ^{1,7}	0-50	0-10	16

Table 2. Seeding chart for introduced plant species cont...

Plant Species	% of Mixture (Range Allowed)		Seeding Rate PLS/acre
	Critical Areas Grassland ^{3/}	Trees, Shrubs & Wildlife	
Sweetclover ^{2,4}	0-20	0-20	10
Intermediate Wheatgrass ^{1,6}	0-75	0-75	30
Meadow Bromegrass	0-100	0-25	30
Meadow Fescue	0-75	0-25	16

1. For critical area seeding used for erosion control, at least 50% from the grassland or wildlife seeding mixture shall be composed of sod forming grasses.
2. Species suitable for frost seeding, increase seeding rate by a factor of 1.5.
3. Mixtures may include up to 20% native grasses. See Table 3 for seeding rates. Use the criteria for the predominate species in the mixture for establishment.
4. Sweet clover is to be used in mixtures only.
5. Reed Canary grass is to be used only for very wet sites with high nutrient load only if Reed Canary grass is already present downstream of the practice.
6. Suitable for well drained sites.
7. Tall Fescue will not consist of more than 10% of the mix if primary or secondary purpose is for wildlife.

Table 3. Seeding chart for native plant species

Grasses ¹	% of Mixture (Range Allowed)	Pure Stand Seeding Rate PLS lbs./acre	Seeds/sq. ft.	Approx. Seeds/ lb.
Big bluestem, <i>Andropogon gerardi</i>	0-100	16	60	165,000
Blue grama, <i>Bouteloua gracilis</i>	0-20	4	75	825,000
Buffalograss, <i>Buchloe dactyloides</i>	0-20	65	60	40,000
Canada wildrye, <i>Elymus canadensis</i>	0-20	22	61	121,000
Eastern gamagrass, <i>Tripsacum dactyloides</i>	0-100	20	4	7,500
Indiangrass, <i>Sorghastrum nutans</i>	0-100	15	60	175,000
Little bluestem, <i>Schizachyrium scoparium</i>	0-20	11	60	240,000
Sideoats gramma, <i>Bouteloua curtipendula</i>	0-20	14	61	191,000
Switchgrass, <i>Panicum virgatum</i> ²	0-100	7	62	389,000
Virginia Wildrye, <i>Elymus virginicus</i>	0-20	27	60	96,000
Western wheatgrass, <i>Agropyroni smithi</i>	0-20	24	61	110,000

1. When developing seed mixtures, except eastern gamagrass, use 60 seeds/sq. ft. for grass stands. Grass and forb/legume mixtures are 40 seeds/sq. ft. for the grass component and minimum of 20 seeds/sq. ft. for forb/legume component.
2. Species suitable for frost seeding, multiply seeding rate by factor of 1.5.

Table 4. Temporary Seeding Recommendations

Fields with atrazine ¹ carryover, lack of suitable seed or late planting date	
Sudangrass	20 lbs./acre
Sorghum-Sudangrass hybrid	20 lbs./acre
Corn	2 bushels/acre
Fields where planting is delayed, due to lack of suitable seeding or late planting date	
Oats	3 bushels/acre
Winter rye	2 bushels/acre
Spring or winter wheat	2 bushels/acre

1. For other herbicide carryover problems, check with the area office.

Table 5. Critical Area Seedbed Mixtures for Specific Site Conditions

Site Conditions	Seeding Mixture	Rate lbs./acre
Moderately to well drained, limed or non-acid, fertile soils	Alfalfa Red clover Smooth brome grass	3 2 15
	Alfalfa Timothy Smooth brome grass Or Orchardgrass	6 2 15 Or 8
Imperfectly drained soils	Red clover Ladino clover Orchardgrass	4 1 8
	Birdsfoot trefoil Smooth brome grass Timothy	5 12 3
	Big bluestem Switchgrass	14 2
Poorly drained soils	Birdsfoot trefoil Timothy Or Orchardgrass	4 8 Or 12
	Alsike clover Ladino clover Tall fescue Or Timothy	2 3 8 Or 5

Table 5. Critical Area Seedbed Mixtures for Specific Site Conditions cont...

Site Conditions	Seeding Mixture	Rate lbs./acre
Very wet sites with high nutrient loading (i.e. animal waste filter strips)	Reed canary grass	16
	Tall fescue	16
	Switchgrass	7
Medium acid to strongly acid (6.0-5.1) with well drained to poorly drained soil that has a high clay content	Birdsfoot trefoil	7
	Tall fescue	5
	Bromegrass	8
Medium to strongly acid (pH 6.0-5.1) shallow (20 in.) with poorly drained soils with low fertility and low level management	Birdsfoot trefoil	4
	Tall Fescue	4
	Red top	3
	Switchgrass	2
Deep or coarse sands, droughty, usually acid (pH 6.0)	Sand lovegrass	2
	Switchgrass	5
	Prairie sandreed grass	4
Reclaimed acid mine spoil (pH 4.0)	Birdsfoot trefoil	4
	Red clover	4
	Crown vetch	4
	Tall fescue	4
Reclaimed acid mine spoil, deep coarse sands, droughty, low fertility (pH 4.0)	Switchgrass	2
	Big bluestem	4
	Indiangrass	4
	Little bluestem	3
Alkaline mine spoil (pH 7.4)	Bromegrass	12
	Alfalfa	10
	Bromegrass Timothy	14 5

Specific Site Requirements:

Refer to construction notes to determine seed mix necessary for each site.

NATURAL RESOURCES CONSERVATION SERVICE CONSTRUCTION SPECIFICATION

Construction Specification 8—Mobilization and Demobilization

1. SCOPE

The work consists of the mobilization and demobilization of the contractor's forces and equipment necessary for performing the work required under the contract. It does not include mobilization and demobilization for specific items of work for which payment is provided elsewhere in the contract. Mobilization will not be considered as work in fulfilling the contract requirements for commencement of work.

2. EQUIPMENT AND MATERIAL

Mobilization shall include all activities and associated costs for transportation of contractor's personnel, equipment, and operating supplies to the site; establishment of offices, buildings, and other necessary general facilities for the contractor's operations at the site; premiums paid for performance and payment bonds including coinsurance and reinsurance agreements as applicable; and other items specified in section 4 of this specification.

Demobilization shall include all activities and costs for transportation of personnel, equipment, and supplies not required or included in the contract from the site; including the disassembly, removal, and site cleanup of offices, buildings, and other facilities assembled on the site specifically for this contract.

This work includes mobilization and demobilization required by the contract at the time of award. If additional mobilization and demobilization activities and costs are required during the performance of the contract as a result of changed, deleted, or added items of work for which the contractor is entitled to an adjustment in contract price, compensation for such costs will be included in the price adjustment for the item or items of work changed or added.

3. PAYMENT

Payment will be made as the work proceeds, after presentation of paid invoices or documentation of direct costs by the contractor showing specific mobilization and demobilization costs and supporting evidence of the charges of suppliers, subcontractors, and others. When the total of such payments is less than the lump sum contract price, the balance remaining will be included in the final contract payment. Payment of the lump sum contract price for mobilization and demobilization will constitute full compensation for completion of the work.

Payment will not be made under this item for the purchase costs of materials having a residual value, the purchase costs of materials to be incorporated in the project, or the purchase costs of operating supplies.

4. ITEMS OF WORK AND CONSTRUCTION DETAILS

A. Measurement and Payment

Compensation for any work item described in the contract documents but not listed in the bid schedule will be included in the payment for the item of work to which it is made subsidiary. Such items and bid items to which they are made subsidiary are identified in Items of Work and Construction Details section of this specification.

For items of work which lump sum prices are established in the contract, the quantity of work will not be measured for payment. Payment for each item will be made at the contract lump sum price and will constitute full compensation for completion of the work.

For items of work for which specific unit prices are established in the contract, the payment will be made based on the approved quantity measured by the engineer or weight tickets. Payment will constitute full compensation of the work completed as defined by each work item.

B. Items of Work and Construction Details

1. Bid Item No. 2

This item shall consist of mobilizing and demobilizing personnel and equipment in preparation to perform the work within the scope of this contract. Mobilization and demobilization for seeding is incidental to this item.

Any work that is necessary to provide access to the site including, but not limited to, grading, temporary culverts, and clearing will be included in this item. When construction is completed access areas will be restored, as close as practical, to its original condition.

Any fence removed for access and /or to provide work area shall be replaced with same or like materials as approved by the engineer.

The Contractor shall exercise caution to minimize the amount of damage caused by the grading and clearing operations.

This item shall not include transportation of personnel, equipment and operating supplies within the work limit areas of this contract.

Payment will constitute full compensation for related subsidiary item, Pollution Control.

Payment will be made as the work proceeds and will be paid out on the percent of the project complete as the work progresses. Payment of the lump sum contract price for mobilization and demobilization will constitute full compensation for the completion of the work.

Contractor is to contact "Iowa One Call" for utility locations a minimum of two (2) days prior to any excavation/construction. The ticket number must be provided to Engineer.

NATURAL RESOURCES CONSERVATION SERVICE CONSTRUCTION SPECIFICATION

IA-9 SUBSURFACE DRAIN INVESTIGATION, REMOVAL, AND REPAIR

1. SCOPE

The work shall consist of investigation, location, repair, and/or removal of subsurface drains (tile) near new or existing animal waste storage facilities or in wetland restoration, enhancement, or creation project areas, or other situations where subsurface drains may be present.

2. INVESTIGATION AND LOCATION

An inspection trench at least 10 inches wide shall be dug at the location shown on the drawings or as directed by the engineer or his representative. The trench shall be at least 6 feet deep measured from the original ground line, unless otherwise shown on the plans. The Engineer or his representative shall examine the trench and excavated material to identify tile lines.

Size, material, operating condition and direction of flow of each conduit shall be documented. Location and flow line elevation of each conduit shall be surveyed with horizontal and vertical control based on benchmarks shown on the plans.

The inspection trench shall be documented by surveying the natural ground and trench bottom location and elevations at the beginning, end, and every 50 feet for trenches longer than 50 feet.

Backfilling shall not be started without approval of the Engineer. See Section 5 for backfill specifications.

Trench shields, shoring and bracing, or other methods necessary to safeguard the workers and work, and to prevent damage to the existing improvements shall be furnished, placed, and subsequently removed by the contractor.

3. TILE REPAIR

Unless designated for removal, replace damaged conduit with new conduit having equal or greater capacity using material specified in Section 6 or 7. When replacing short sections of clay or concrete tile with single-wall corrugated polyethylene pipe, use the next larger nominal size.

Make connections with manufactured fittings and tight joints. Where joints have gaps that would allow soil to enter, cover the joint with a permanent type material such as coal tar pitch treated roofing paper, fiber glass sheet or mat, or plastic sheet.

If the investigation trench has been excavated below the existing drain grade, backfill the trench with gravel or well-pulverized soil in layers not over four (4) inches thick and tamp by hand or manually directed power tamper to provide a firm foundation for the conduit at the existing grade. Do not backfill with any soil containing broken tile fragments.

Using selected soil free of hard clods, rocks, or frozen soil, hand tamp the backfill material around the haunch of the pipe in layers not over four (4) inches thick to provide support. Hold the conduit in place mechanically while placing excavated material around and over the conduit to ensure proper alignment and grade is maintained. Complete the backfill operation according to Section 5.

4. TILE REMOVAL

Remove conduits as shown on the plans or directed by the Engineer or his representative, including envelope filter material or other flow enhancing material when present.

Cap or plug the open ends of the disconnected conduit to prevent soil entry when the conduit will continue to function downstream, or otherwise shown on the plans. For a minimum distance of two feet around each sealed conduit end, backfill in layers not over four (4) inches thick and tamp by hand or manually directed power tamper to a density equal to or greater than the surrounding undisturbed soil. Do not backfill with any soil containing broken tile fragments, large stones, frozen material, or large dry clods.

Where tile are located beneath an existing animal waste facility, remove the tile or fill the entire length of tile with concrete or Portland cement grout as shown on the plans. When tile removal is specified, the owner shall contact the Iowa Department of Natural Resources (IDNR) for permission to remove the drainage tile under the structure. The structure shall be emptied of waste or lowered to a point below the tile prior to its removal. The structure must be retested for percolation and the results submitted to IDNR and approval received prior to reusing the structure.

If shown on the plans or directed by the engineer, reroute upstream drain lines so the capacity of the upstream drainage system is maintained. Install conduit in accordance with Iowa Construction Specification IA-46, Tile Drains for Land Drainage.

5. BACKFILL

Compact soil around disturbed tile as specified in Section 3 (Tile Repair) and Section 4 (Tile Removal). Keep the backfill within 5 feet of the conduit free from large stones, frozen material, and large dry clods. Unless otherwise shown on the plans, backfill the remainder of the trench as follows:

For trenches located under or near structures, backfill in 12-inch layers and compact each layer to a density equal to or greater than the surrounding undisturbed soil.

For other locations, backfill the remainder of each trench with the excavated soil material which shall extend above the ground surface and be well rounded over the trench.

6. MATERIALS

Unless otherwise shown on the plans, conduit and fittings used for repair shall conform to the specifications listed in Table 1. Perforated pipe shall have a water inlet area of at least 1 square inch per foot, provided by perforations spaced uniformly along the long axis of the pipe. The perforations shall be circular or slots. Circular perforations shall not exceed 3/16 inch in diameter. Slots shall not be more than 1/8 inch wide.

Table 1. Acceptable pipe for subsurface drain repair

Kind of Pipe [#]	Specification
Corrugated Polyethylene (PE) Pipe and Fittings, 3 to 6 inch	ASTM F 405
Corrugated Polyethylene (PE) Pipe and Fittings, 3 to 24 inch	ASTM F 667
Corrugated Profile Wall (Dual Wall) Polyethylene (PE) pipe, 2 to 60 inch	ASTM F 2648 ^{\$}
Corrugated Profile Wall (Dual Wall) Polyethylene (PE) pipe, 12 to 60 inch	ASTM F 2306 ^{\$}

Polyvinyl Chloride (PVC) Plastic Pipe, Schedules 40, 80 and 120	ASTM D 1785
PVC Pressure-Rated Pipe (SDR Series)	ASTM D 2241
Clay drain tile	ASTM C 4
Concrete drain tile	ASTM C 412

#Pipe sizes are nominal and the ranges are inclusive

\$Pipe conforming to AASHTO M 252 (3 to 10 inch), or AASHTO M 294 (12 to 60 inch) is acceptable.

7. SPECIFIC SITE REQUIREMENTS

A. Measurement and Payment

Compensation for any work item described in the contract documents but not listed in the bid schedule will be included in the payment for the item of work to which it is made subsidiary. Such items and bid items to which they are made subsidiary are identified in Items of Work and Construction Details section of this specification.

For items of work which lump sum prices are established in the contract, the quantity of work will not be measured for payment. Payment for each item will be made at the contract lump sum price and will constitute full compensation for completion of the work.

For items of work for which specific unit prices are established in the contract, the payment will be made based on the approved quantity measured by the engineer or weight tickets. Payment will constitute full compensation of the work completed as defined by each work item.

B. Items of Work and Construction Details

1. Bid Item No. 3

This item will consist of the excavation necessary to locate and verify the connection locations and elevations for the existing tiles shown on the plans. This item shall also include backfilling of the trenches.

The Contractor shall locate and verify existing tile location(s) and elevation(s) prior to construction and shall notify the Engineer of any discrepancies.

If extra work is required to locate additional tile not shown on the drawings, the Contractor can request additional compensation, but it must be first approved by the Division.

Measurement for this item shall be measured in hours to the nearest tenth of an hour. Payment for Tile Investigation shall be made as noted in the plans.

Construction Specification 000 IA-21 Excavation

1. SCOPE

The work shall consist of the excavation required by the drawings and specifications and disposal of the excavated materials. The cutoff trench and any other required excavations shall be dug to the lines and grades shown on the drawings or as staked in the field. Structure or trench excavations will conform to all safety requirements of OSHA.

2. USE OF EXCAVATED MATERIALS

Suitable materials from the specified excavations shall be used in the construction of required permanent earth fill. The suitability of materials for specific purposes shall be determined by the NRCS Inspector.

3. DISPOSAL OF WASTE MATERIAL

All surplus or waste material shall be disposed of in areas shown on the drawings or as approved by the NRCS Inspector. The waste material shall be smoothed and sloped to provide drainage.

4. STRUCTURE AND TRENCH EXCAVATION

Structure or trench excavations will conform to all safety requirements of OSHA.

5. BORROW EXCAVATION

When the quantities of suitable materials obtained from specified excavations are insufficient to construct the specified fills, additional materials shall be obtained from the designated borrow areas as shown on the drawings or as approved by NRCS and the landowner. On wetland projects, borrow shall not be taken from the wetland area within 10 feet of the embankment or as shown on the drawings.

Borrow areas shall be excavated and grading completed in a manner to eliminate steep or unstable side slopes or hazardous or unsightly conditions.

6. OVER-EXCAVATION

Excavation beyond the specified lines and grades shall be corrected by filling the resulting voids with compacted earthfill, except that if the earth is to become the subgrade for riprap, sand or gravel bedding or drainfill, the voids shall be filled with material conforming to the specifications for the riprap, bedding or drainfill, as appropriate.

7. SPECIFIC SITE REQUIREMENTS

A. Measurement and Payment

Compensation for any work item described in the contract documents but not listed in the bid schedule will be included in the payment for the item of work to which it is made subsidiary. Such items and bid items to which they are made subsidiary are identified in Items of Work and Construction Details section of this specification.

For items of work which lump sum prices are established in the contract, the quantity of work will not be measured for payment. Payment for each item will be made at the contract lump sum price and will constitute full compensation for completion of the work.

For items of work for which specific unit prices are established in the contract, the payment will be made based on the approved quantity measured by the engineer or weight tickets. Payment will constitute full compensation of the work completed as defined by each work item.

The volume of excavation as provided in the bid quantities has been determined from the topographic information shown on the Drawings using a computer program. Payment will be made based on the planned quantities provided unless additional excavation is directed by the Engineer. Excavation resulting from the contractor's improper construction operations, as determined by the Engineer, is not included for measurement and payment.

B. Items of Work and Construction Details

"Excavation":

1. Bid Item No. 6

This item will consist of excavation and stockpiling of material for construction of the bioreactor pits/chambers as shown in the plans:

Excavations required for the placement of tile exploration, new tile installation, and CMP outlets are not included in this bid quantity and will not be measured for payment. The cost of excavation for these items are incidental and should be included as part of their corresponding bid items.

This item does not include the excavation for site stripping or topsoil, which is covered under Specification IA-CS-001. "Site Preparation".

This item includes the hauling of excavated material to be used on site as earthfill.

Payment will be based on plan quantity, in cubic yards. No additional field measurement is to be made.

Payment will constitute full compensation for the following related Subsidiary items: Pollution Control and Structure Excavation.

"Overhaul"

2. Bid Item No. 8

This item will consist of hauling excess spoil material not used for earthfill or salvaged topsoil. Item also includes all placing, grading and shaping, and/or disposing of material. Contractor shall coordinate with the landowner regarding placement in an adjacent field. Any material not desired by the landowner to be placed in an adjacent field shall become property of the contractor.

Excess spoil material will be required to be placed outside of the mapped floodplain extents. All sites are located within mapped floodplains. Bioreactors on Site 8 and Site 21 are anticipated to have excess spoil needing to be placed outside of floodplain extents. Refer to plans.

Payment will be based on plan quantity, in cubic yards. No additional field measurement is to be made.

3. Subsidiary Item - Structure Excavation

This item shall consist of the excavation necessary to install the pipe, CMP tile outlets, and water control structures in the locations and as shown on the drawings.

No separate payment will be made for Structure Excavation. Compensation for this item will be included in payment with the corresponding bid items.

Construction Specification 000 IA-23 Earthfill

1. SCOPE

The work shall consist of the construction of earth fills required by the drawings and specifications. The completed work shall conform to the lines, grades, and elevations shown on the drawings or as staked in the field.

2. MATERIALS

All fill materials shall be obtained from required excavations and designated borrow areas. Fill materials shall contain no sod, brush, roots or other bio-degradable materials. Rocks larger than 6 inches in diameter shall be removed prior to compaction of the fill.

3. FOUNDATION PREPARATION

Foundations for earthfill shall be stripped a minimum of 6 inches to remove vegetation and other unsuitable materials. Foundation surfaces shall be scarified to a minimum depth of 2 inches prior to placing fill material.

Foundation and abutment surfaces shall not be sloped steeper than 1.5 horizontal to 1 vertical unless otherwise shown on the drawings.

4. PLACEMENT

Fill shall not be placed until the required excavation and foundation preparation have been completed and the foundation has been inspected and approved by NRCS. Fill shall not be placed upon a frozen surface, nor shall snow, ice, or frozen material be incorporated in the fill.

Adjacent to structures or pipes, fill shall be placed in a manner which will prevent damage. The height of the fill adjacent to structures or pipes shall be increased at approximately the same rate on all sides.

The materials used throughout the earth fill shall be essentially uniform. Selective placement shall be as shown on the drawings or approved by NRCS.

If the surface of any layer becomes too hard and smooth for proper bond with the succeeding layer, it shall be scarified to a minimum depth of 2 inches before the next layer is placed.

The top surfaces of embankments shall be maintained approximately level during construction, except that a cross-slope of approximately 2% shall be maintained to ensure effective drainage.

When moving fill material from the borrow area(s) to the embankment by use of bulldozers only, the following steps shall be followed:

- Immediately after the borrow material is pushed to the embankment, it shall be spread in horizontal lifts placed parallel to the centerline of the embankment.
- Compactive effort will then be applied by operating equipment parallel to the centerline of the fill or embankment.
- Lift thicknesses shall be in strict compliance with Clause 6, below.

Sectional fills are not allowed unless they are shown on the construction drawings.

5. CONTROL OF MOISTURE CONTENT

The moisture content of the fill material shall be adequate for obtaining the required compaction. Material that is too wet shall be dried to meet this requirement, and material that is too dry shall have water added and mixed until the requirement is met.

The moisture content of the fill material shall be such that a ball formed with the hands does not crack or separate when struck sharply with a pencil and will easily ribbon out between the thumb and finger.

Earth foundations under and adjacent to concrete structures shall be prevented from drying and cracking before concrete and backfill are placed.

The application of water to the fill materials shall be accomplished at the borrow areas insofar as possible.

6. COMPACTION

Earth fill shall be compacted by one of the following methods as specified on the plans or in Section 8, Special Specifications. If no method is specified, compaction will be in accordance with Method 1.

- Method 1 - Earthfill shall be placed so that the wheels or tracks of the loaded hauling equipment, traveling in a direction parallel to the centerline of fill, pass over the entire surface of each layer being placed. Low ground pressure vehicles shall not be used for this purpose.
- Method 2 - Two (2) complete passes of a tamping-type roller will be made over each layer. The roller shall be capable of exerting a minimum force of two hundred (200) pounds per square inch.
- Method 3 - Minimum density shall be 90% of the maximum density as determined by ASTM D 698 and as shown on the plans.

The maximum thickness of a lift of fill before compaction shall be 9 inches, unless otherwise indicated on the drawings.

Fill adjacent to structures, pipe conduits, and appurtenances shall be placed in layers not more than 4 inches thick and compacted to a density equivalent to that of the surrounding fill. Methods used to obtain compaction for fine or coarse grained materials are as follows:

- For fine grained materials, hand tamping or manually directed power tampers may be used. Hand compaction only shall be used to compact the earthfill under the bottom half of circular pipes. Manually directed power tampers shall not be used in tight spaces where applying full compactive effort will result in direct contact of the tamper plate with the pipe. Care should be taken so that compaction around the spillway pipe does not cause uplift of the pipe resulting in a void beneath the pipe.
- For coarse grained materials (sands and gravels), vibratory plate compactors shall be used for obtaining compaction. However, hand tamping shall be used to compact the material under the bottom half of circular pipes.

In all cases, follow manufacturer instructions for the specific compaction equipment being used. Heavy equipment shall not be operated within 2 feet of any structure or pipe.

Compacting of fill adjacent to concrete structures shall not be started until the concrete is 7 days old.

7. ISLANDS, MOUNDS, AND LOAFING AREAS ON WETLAND RESTORATION, ENHANCEMENT, OR CREATION PROJECTS

Islands shall be randomly located within the wetland area at locations shown on the drawings or as staked in the field. The orientation of island shorelines shall be random with attention given to prevailing

winds to limit wave damage. In general, the side of the island with the longest dimension shall be parallel to the prevailing wind direction. Side slopes of islands shall be as shown on the drawings, but in no case shall be steeper than 6 horizontal to 1 vertical. Island shapes shall be irregular.

Loafing areas shall be constructed in the areas shown on the drawings or as staked in the field and shall be graded to drain runoff water. The elevation of at least one loafing area should be above the maximum water level whenever possible.

Excavated material not suitable for embankments, wetland dikes, or islands can be used to create mounds or blended into surrounding topography to create a natural appearance. Spoil material shall not be spread on existing wetland areas.

Organic soils shall not be used to construct islands, loafing areas, dikes, or embankments.

8. SPECIFIC SITE REQUIREMENTS

A. Measurement and Payment

For items of work which specific unit prices are established in the contract, the volume of earthfill will be computed to the nearest cubic yard by the method of average cross-sectional end areas. No deduction in volume will be made for embedded items, such as, conduits inlet structures and their appurtenances. The pay limits for computation shall be as shown on the drawings with the further provisions that earthfill voids resulting from over excavation of the foundation, outside specified lines and grades, will be included in the measurement for payment only under the following conditions:

- Where such over excavation is directed by the engineer to remove unsuitable material, and
- Where the unsuitable condition is not a result of the contractor's improper construction operations as determined by the engineer.

Earthfill beyond the specified lines and grades to backfill excavation required for compliance with OSHA requirements will be considered subsidiary to the earthfill bid item(s).

Payment for each type and compaction class of earthfill and earth backfill is made at the contract unit price for that type and compaction class of earthfill. Such payment will constitute full compensation for all labor, material, equipment, and all other items necessary and incidental to the performance of the work.

Compensation for any item of work described in the contract, but not listed in the bid schedule is included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in this specific section.

B. Items of Work and Construction Details

Items of work to be performed in conformance with this specification and the construction details therefore are:

"Earthfill":

1. Bid Item No. 7

This item shall consist of the earthfill necessary to construct the bioreactor soil caps and adjacent site grading around the bioreactors as shown in the plans. Cohesive material found

during general grading and bioreactor excavation can be used for these areas. Sand and gravel found on site shall not be used for this earthfill.

Method 1 compaction shall be used for material that is to be placed on top of the bioreactors.

Rocks larger than 6" shall be removed from the site and not used as earthfill.

Payment for these items shall be based on plan quantity unless additional work is approved by the Division. The plan quantity is based on neat lines and does not account for any shrinkage.

Payment will constitute full compensation for the following related Subsidiary items: Pollution Control and Backfill Required Excavation.

2. Subsidiary Item - Backfill Required Excavation

This item shall consist of backfilling the areas excavated to install the other components related to the project such as piping or structures and to locate and remove the tile lines.

Compaction adjacent to the structures shall be as indicated above.

No separate payment will be made for Backfill of Structure Excavation.

Construction Specification 000 IA-24 Drainfill

1. SCOPE

The work shall consist of furnishing and placing drainfill required in the construction of structure drainage systems and filter diaphragms around conduits.

2. MATERIALS

Drainfill shall be sand, gravel, or crushed stone. It shall be composed of clean, hard, durable mineral particles free from organic matter, clay balls, soft particles, or other substances that would interfere with their free-draining properties. Aggregates of crushed limestone may be used only for coarse drainfill but shall be thoroughly washed and screened so that not more than 3 percent by weight is finer than a No. 4 sieve.

Coarse drainfill shall be graded as follows:

U.S. Sieve Designation	Percent Passing Sieve
1 1/2	100
3/4	75-100
1/2	25-80
3/8	20-60
No. 4	0-10
No. 8	0-5
No. 100	0-3

Fine drainfill shall be graded as follows:

U.S. Sieve Designation	Percent Passing Sieve
3/8	100
No. 4	95-100
No. 8	75-95
No. 16	50-70
No. 30	25-50
No. 50	10-20
No. 100	0-6
No. 200	0-3

3. BASE PREPARATION

Foundation surfaces and trenches shall be free of organic matter, loose soil, foreign substances, and standing water when the drainfill is placed.

4. PLACEMENT

Drainfill shall not be placed until the trench excavation has been inspected and approved by NRCS. Installation of the drainage conduit shall be inspected and approved by NRCS before covering it with

drainfill. No foreign materials shall be allowed to become intermixed with or otherwise contaminate the drainfill. Drainfill material shall be placed in a manner to avoid segregation of particles by size.

5. COMPACTION

1. Foundation Trench Drain
 - a. No compaction will be required beyond that resulting from the placing and spreading operations.
2. Filter Diaphragm
 - a. Each layer of sand material shall be flooded with clean water prior to compaction.
 - b. Compaction shall be accomplished while the material is wet from step (1) above.
 - c. Each layer shall be compacted by a minimum of 2 passes of a hand directed vibratory plate compactor over the entire layer surface.
 - d. Layer thickness shall not exceed 12 inches after compaction.
3. Filter Diaphragm Outlet
 - a. Sand material shall be placed so the layer thickness does not exceed 4 inches after compaction.
 - b. Each layer shall be compacted by a minimum of 2 passes of a hand directed vibratory plate compactor over the entire layer surface.

6. SPECIFIC SITE REQUIREMENTS

A. Measurement and Payment

Compensation for any work item described in the contract documents but not listed in the bid schedule will be included in the payment for the item of work to which it is made subsidiary. Such items and bid items to which they are made subsidiary are identified in Items of Work and Construction Details section of this specification.

For items of work which lump sum prices are established in the contract, the quantity of work will not be measured for payment. Payment for each item will be made at the contract lump sum price and will constitute full compensation for completion of the work.

For items of work for which specific unit prices are established in the contract, the payment will be made based on the approved quantity measured by the engineer or weight tickets. Payment will constitute full compensation of the work completed as defined by each work item.

B. Items of Work and Construction Details

“Rock – 1.5” Washed Aggregate”:

1. Bid Item No. 13

This item is for construction of the aggregate envelope associated with the bioreactor dispersion and collection pipes.

Measurement and payment shall be on a plan quantity. No field measurement shall be made.

Construction Specification

000 IA-26 Topsoiling

1. SCOPE

The work shall consist of salvaging topsoil from borrow areas or required excavations and spreading it on the exposed disturbed areas.

2. QUALITY OF TOPSOIL

Topsoil shall consist of friable surface soil reasonably free of grass, roots, weeds, sticks, stones, or other foreign materials.

3. EXCAVATION

After the site has been cleared and grubbed, the topsoil shall be removed from borrow areas and required excavation areas to the depth as shown on the drawings. Topsoil shall be stockpiled at locations approved by NRCS.

4. SPREADING

Spreading shall not be done when the ground or topsoil is frozen, excessively wet, or otherwise in a condition detrimental to the work. Surfaces designated to be covered shall be lightly scarified just prior to the spreading operation. Where compacted fills are designated to be covered by topsoil, the topsoil shall be placed concurrently with the fill and shall be bonded to the compacted fill with the equipment.

Topsoil shall be placed to the minimum depth shown on the drawings. After the spreading operation is completed, the surface shall be finished to a reasonably smooth surface.

5. SPECIFIC SITE REQUIREMENTS

A. Measurement and Payment

Compensation for any work item described in the contract documents but not listed in the bid schedule will be included in the payment for the item of work to which it is made subsidiary. Such items and bid items to which they are made subsidiary are identified in Items of Work and Construction Details section of this specification.

For items of work which lump sum prices are established in the contract, the quantity of work will not be measured for payment. Payment for each item will be made at the contract lump sum price and will constitute full compensation for completion of the work.

For items of work for which specific unit prices are established in the contract, the payment will be made based on the approved quantity measured by the engineer or weight tickets. Payment will constitute full compensation of the work completed as defined by each work item.

B. Items of Work and Construction Details

1. Bid Item No.	9			
9. Topsoil Stripping		IA-001; IA-026	352	CY

This item will consist of spreading salvaged and stockpiled topsoil as the surface layer of all excavations and earthfills that will be seeded. Topsoil shall be placed as final lift.

This item will consist of work to remove and dispose of existing material to remove vegetation on areas to be excavated or filled. Total depth of vegetative stripping and topsoil stripping shall equal a combined depth of 12", with the estimated cubic yards of top soil removal as shown in the plans. The topsoil replacement quantity shall be paid separately.

This item will also include any tree and brush removal along with any fences. These shall be considered incidental to site stripping.

Areas to receive a minimum of 12-inch layer of topsoil include all open trench and structure excavations, bioreactor grading and soil caps, and any other areas noted in the plans.

Grading areas with less than 6 inches of cut will not require topsoil resspreading unless required by engineer.

Measurement and payment for Topsoiling shall be by cubic yard, per plan quantity. Plan quantity listed in the proposal will be used to measure and pay for the bid, no field measurement shall be made.

Payment will constitute full compensation for the following related subsidiary items: Topsoil stripping per Site Preparation and Pollution Control.

Construction Specification 000 IA-45 Plastic (PVC, PE) Pipe

1. SCOPE

The work shall consist of furnishing and installing plastic pipe and the necessary fittings specified herein or as shown on the drawings. This specification does not cover subsurface drainage systems.

2. MATERIALS

Corrugated Polyethylene (PE) Tubing. Corrugated PE tubing and fittings shall conform to the requirements of the applicable specification listed below:

<u>Kind of Pipe</u>	<u>Specification</u>
Corrugated Polyethylene(PE) Tubing and Fittings, Nominal Sizes 3 to 6 inch, inclusive.....	ASTM F 405
Large Diameter Corrugated Polyethylene Tubing and Fittings, Nominal Sizes 8 to 24 inch, inclusive.....	ASTM F 667
Polyethylene (PE) Large Diameter Profile Wall Sewer and Drain Pipe.....	ASTMF 894

Poly(Vinyl Chloride) (PVC) Plastic Pipe. PVC pipe and fittings shall conform to the requirements of the applicable specification listed below:

<u>Kind of Pipe</u>	<u>Specification</u>
PVC Plastic Pipe, Schedules 40, 80 and 120.....	ASTM D 1785
PVC Pressure-Rated Pipe (SDR Series).....	ASTM D 2241
PVC Pressure Pipe, 4 in. through 12 in., for Water Distribution.....	AWWA C900
PVC Water Transmission Pipe, Nominal Diameters 14 in through 36 in.....	AWWA C905

PVC and PE Plastic Pipe. Plastic pipes meant for non-potable, livestock water supply shall conform to the requirements of the applicable specification listed below:

<u>Kind of Pipe</u>	<u>Specification</u>
Polyethylene (PE) Plastic Pipe, (SIDR-PR) Based on Controlled Inside Diameter.....	ASTM D 2239
PVC Pressure-Rated Pipe (SDR Series).....	ASTM D 2241

3. FITTINGS AND JOINTS

Pipe joints shall conform to the details shown on the drawings. Pipe shall be installed and joined in accordance with the manufacturer's recommendations.

Joints may be bell and spigot type with elastomeric gaskets, coupling type with elastomeric gasket on each end, or solvent cemented. Gaskets shall conform to ASTM D 1869. Solvent cemented joints shall not be used for pond spillway pipes. Solvent cemented joints for PVC pipe and fittings shall be in

accordance with ASTM D 2855. When a lubricant is required to facilitate joint assembly, it shall be a type having no detrimental effect on the gasket or pipe material.

Mechanical joints (split couplings and snap couplings) may be used when joining PE pipe and fittings when the pipe is used for non-pressure flow and a free draining sand or gravel bedding material is provided. Elastomeric-sealed mechanical joints shall be used when joining PE pipe and fittings under pressure flow or where seepage cannot be tolerated. Where non-pressure pipe is specified, the fittings shall be of the same or similar materials as the pipe and shall provide the same durability and strength as the pipe.

A special case of livestock water supply involves pipes through a dam or embankment. Only PE pipe meeting the above specification may be used. PE pipe, of 1 ¼, 1 ½, or 2-inch diameter shall be installed so that there are no joints within the embankment area.

Where pressure pipe is specified, fittings shall have a design capacity equal to or exceeding that specified for the pipe to which it is attached. Fittings shall be cast iron, steel, one piece injection molded plastic fitting or fabricated from plastic pipe and one piece injection molded plastic fittings. Pressure pipe fittings shall conform to the requirements of the applicable specification listed below.

<u>Kind of Fitting</u>	<u>Specification</u>
Threaded PVC Plastic Pipe Fittings, Schedule 80.....	ASTM D 2464
PVC Plastic Pipe Fittings, Schedule 40.....	ASTM D 2466
PVC Plastic Pipe Fittings, Schedule 80.....	ASTM D 2467
Butt Heat Fusion (PE) Plastic Fittings for PE Plastic Pipe and Tubing.....	ASTM D 3261
Joints for Plastic Pressure Pipes Using Flexible Elastomeric Seals.....	ASTM D 3139
PVC Pressure Pipe, 4 in. through 12 in., for Water Distribution.....	AWWA C900
PVC Water Transmission Pipe, Nominal Diameters 14 in through 36 in.....	AWWA C905

4. HANDLING AND STORAGE

Pipe shall be delivered to the job site and handled by means which provide adequate support to the pipe and does not subject it to undue stresses or damage. When handling and placing plastic pipe, care shall be taken to prevent impact blows, abrasion damage, and gouging or cutting (by metal surfaces or rocks). All special handling requirements of the manufacturer shall be strictly observed. Special care shall be taken to avoid impact when the pipe must be handled at temperatures of 40 degrees F (4.4 degrees C) or less.

Pipe shall be stored on a relatively flat surface so that the barrels are evenly supported. Unless the pipe is specifically coated to withstand exposure to ultraviolet radiation, it shall be covered with an opaque material when stored outdoors for a period of 15 days or longer.

5. TRENCHING

Plastic pipe conduits shall be installed in trenches or plowed in according to the following methods:

1. **Trencher Constructed** - When conditions permit, trenching for pipelines, which are buried from 5 to 6 feet deep, are usually done with a narrow 4 to 6 inch wide chain trencher. Where there is little gravel and the ground is not too wet, these trenchers bring up well pulverized soil that makes good backfill material. Where rocks are not present, any of this material may be backfilled directly around the pipe. There is no practical way to compact the fill in these narrow trenches. The owner must be made aware that this material normally consolidates to its maximum extent in two to five years, but depressions or low spots can be hazards to livestock, humans and equipment.

2. **Backhoe Constructed Trench** – Backhoe trenches are usually a minimum of 12 inches wide. The material frequently comes out of the trench as clods, large chunks, and rocks. Immediately backfill over the pipe with 4 to 6 inches of soil that is free of these clods, large chunks, and rocks. If adequate excavated material is not available, then material such as sand or fine gravel should be imported and placed around the pipe to a depth of 4 to 6 inches over the top of the pipe. Fill the trench with the remaining excavated material.
3. **Plowing** – Plowing, or ripping, is a trenchless method for installing plastic pipe. It is a multi-stage process consisting of positioning a vibrating or static (non-vibrating) plow equipped with a trailing product guide which feeds pipe to the depth setting of the plow as it moves forward. The pipe is inserted into the ground continuously along a predetermined path and depth. The vertical depth of installation is controlled by hydraulic adjustment of the plow shear head and the surface contours. The depth of insertion must be continually adjusted to compensate for changes in terrain.

6. LAYING AND BEDDING THE PIPE

Plastic pipe conduits and fittings shall be installed as shown on the drawings and specified herein. The pipe shall be laid so that there is no reversal of grade between joints, unless otherwise shown on the drawings. The pipe shall be placed with the bell end upstream, unless otherwise specified. The pipe shall be carefully placed on the bedding or into the pipe trench.

Care shall be taken to prevent distortion and damage during unusually hot (over 90 degrees F) or cold weather (under 40 degrees F). After the pipe has been assembled in the trench, it shall be allowed to reach ground temperature before backfilling to prevent pull out of joints due to thermal contraction.

The pipe ends and the couplings shall be free of foreign material when assembled. During the placement of the pipe, each open end of the pipeline shall be closed off by a suitable cover or plug at the end of work on the pipeline each day and until work resumes or installation is complete.

Perforated pipe shall be laid with the perforations down and oriented symmetrically about the vertical centerline. Perforations shall be clear of any obstructions when the pipe is laid.

Pipe shall be firmly and uniformly supported throughout the entire length. Bell-holes shall be made in the bedding under bells or couplings and other fittings to prevent the pipe from being supported by fittings.

1. **Earth Bedding.** When bedding is specified, the pipe shall be firmly and uniformly bedded in a shaped bedding groove that closely conforms to the bottom of the pipe for a depth equal to a minimum of 1 inch or 5 percent of the diameter of the pipe, whichever is greater. The bedding material shall be free of rocks or stones greater than 0.5 inch diameter and earth clods greater than 2 inch diameter.
2. **Sand or Gravel Bedding.** When sand or gravel bedding is specified, the pipe shall be firmly and uniformly placed on a sand or gravel bed. Sand or gravel fill shall be carefully placed and compacted as specified herein and as shown on the drawings.

A few installations of above ground pipelines have been noted. These installations are normally laid directly on the ground and very close to an existing fence line for protection. Only those pipelines designed to withstand exposure to ultraviolet radiation may be utilized for these installations.

Adequate thrust control shall be incorporated in these installations.

7. BACKFILL

The pipe shall be held down during backfilling to the top of the pipe to prevent its being lifted from its original placement.

Within 2 feet of the pipe, backfill shall be carefully placed and compacted by means of hand tamping or manually directed power tampers or plate vibrators to form a continuous uniform support around the pipe. Maximum thickness of layers before compaction within 2 feet of the pipe shall be 4 inches and at more than 2 feet from the pipe a maximum thickness before compaction shall be 9 inches. Unless otherwise specified, the initial backfill shall be compacted to a density equivalent to that of the adjacent fill or foundation materials.

The water content of cohesive backfill material shall be such that, kneaded in the hand, the soil will form a ball which does not readily separate. For non-cohesive sand and gravel backfill material, water content is not a concern for thin lifts.

8. SPECIFIC SITE REQUIREMENTS

A. Measurement and Payment

Compensation for any work item described in the contract documents but not listed in the bid schedule will be included in the payment for the item of work to which it is made subsidiary. Such items and bid items to which they are made subsidiary are identified in Items of Work and Construction Details section of this specification.

For items of work which lump sum prices are established in the contract, the quantity of work will not be measured for payment. Payment for each item will be made at the contract lump sum price and will constitute full compensation for completion of the work.

For items of work for which specific unit prices are established in the contract, the payment will be made based on the approved quantity measured by the engineer or weight tickets. Payment will constitute full compensation of the work completed as defined by each work item.

B. Items of Work and Construction Details

“Anti-Seep Device”

1. Bid Item No. 4

This item includes installation of an anti-seep device at the locations shown on the plans. Item shall be either pre-manufactured gum rubber collar or bentonite clay. Anti-Seep Device shall extend 6-inches in width and depth beyond the extents of the open trench. Device shall be manufacturer-produced or made of bentonite pellets and formed to a minimum 4-inch width.

Measurement and Payment for the Anti-Seep Devices shall be a per Each item, and shall include all necessary work to install device.

**NATURAL RESOURCES CONSERVATION SERVICE
CONSTRUCTION SPECIFICATION**

IA-46 TILE DRAINS FOR LAND DRAINAGE

1. SCOPE

The work shall consist of furnishing and installing drainage tubing and tile and the necessary fittings and appurtenances.

2. MATERIALS

Concrete drain tile shall conform to the requirements of ASTM C 412 and clay drain tile shall conform to the requirements of ASTM C 4.

Corrugated polyethylene (PE) pipe (tubing) and fittings shall conform to ASTM F 405 (3" to 6") or F 667 (3" to 24"), as appropriate. Corrugated profile wall (dual wall) polyethylene (PE) pipe shall meet or exceed the requirements of ASTM F 2648 (2" to 60") or ASTM F 2306 (12" to 60"). Pipe conforming to AASHTO M 252 (3" to 10") or AASHTO M 294 (12" to 60") is acceptable. Perforated tubing shall have a water inlet area of at least 1 square inch per foot, provided by perforations spaced uniformly along the long axis of the tubing. The perforations shall be circular or slots. Circular perforations shall not exceed 3/16 inch in diameter. Slots shall not be more than 1/8 inch wide.

3. EXCAVATION

Unless otherwise specified, excavation for and subsequent installation of each drain line shall begin at the outlet end and progress upstream.

The trench or excavation for the tile shall be constructed to the line, depths, cross sections, and grade shown on the drawings or as directed by the NRCS Inspector. The trench bottom shall be smooth and free of exposed rock. If rock is encountered in the trench bottom, over-excavate the trench and place at least 6 inches of compacted earth or sand bedding in the trench to bring it up to the conduit grade.

If not otherwise shown on the drawings, trench width at the top of the conduit shall be the minimum required to permit installation and provide bedding conditions suitable to support the load on the conduit, but with not less than three (3) inches of clearance on each side of the conduit. Maximum trench width shall be the conduit diameter plus 12 inches measured at the top of the conduit, unless approved bedding is installed.

Trench shields, shoring and bracing, or other methods, necessary to safeguard the workers and work, and to prevent damage to the existing improvements shall be furnished, placed, and subsequently removed by the contractor.

Plow installation is allowed. Minimum trench width shall be two (2) inches wider than the conduit on each side. Grade control and bedding conditions shall be closely inspected during plow installation. Boulders, cobbles, or cemented soil can cause the plow to jump or lose grade. These hardpoints can also puncture or dimple and deform the pipe.

4. PREPARING THE BEDDING

Unless otherwise specified, no filter or envelope is required. In stable soils the bottom of the trench shall be shaped to form a semicircular, trapezoidal, or 90 degree "V" groove in its center. The groove shall be shaped to fit the size of tile. The 90-degree "V" groove shall not be used on conduits greater than 6 inches in diameter.

If the bottom of the trench does not provide a sufficiently stable or firm foundation for the drain tile, a sand-gravel mix or other approved materials shall be used to stabilize the bottom of the trench.

5. FILTER OR ENVELOPE MATERIAL

When a filter is specified, the shape of the bottom of the trench, gradation and the thickness of the filter or envelope material to be placed around the tile will be as shown on the drawings. The envelope or filter material shall be placed in the bottom of the trench just prior to the laying of the tile. The tile shall then be laid and the envelope or filter material placed over the tile.

6. PLACEMENT AND JOINT CONNECTIONS

All drains shall be laid to grade.

Joints between lateral drain tile shall vary with soil type as follows:

- a. Peat and muck - 1/4 inch preferred, 3/8 inch maximum
- b. Clay - 1/8 inch preferred, 1/4 inch maximum
- c. Silt and loam - 1/16 inch preferred, 1/8 inch maximum
- d. Sand - tightest possible fit.

Joint between main drain tile which serve only to collect and transport drainage water from lateral tile lines should be the tightest fit possible.

Where the joint width exceeds the maximum above, the joint shall be covered with a permanent type material such as coal tar pitch treated roofing paper, fiber glass sheet or mat, or plastic sheet.

After placement and blinding of plastic tubing, but prior to backfilling, sufficient time shall elapse to allow the tubing to reach the ambient temperature of the trench. All split fittings shall be securely tied with nylon cord before backfill is placed. When corrugated plastic tubing is used, no more than 5% stretch will be allowed.

7. CONNECTIONS

Lateral connections will be made with manufactured appurtenances (wyes, tees, etc.) comparable in strength and durability with the specified tile or tubing unless otherwise shown on the drawings.

Existing tile lines not shown on the drawings but encountered during installation shall be bridged across the trench or connected into the new line, as directed by NRCS.

Connections with the outlet pipe shall be made watertight.

8. OUTLETS

A continuous section of non-perforated conduit at least 20 feet long shall be used at the outlet. At least two-thirds of the outlet pipe shall be buried in the ditch bank, and the cantilever section must extend to the toe of the ditch side slope or the side slope protected from erosion. Acceptable materials for use at the outlet include the following:

- a. Corrugated metal pipe, galvanized or aluminum, 16 gauge minimum;
- b. Smooth steel pipe with a minimum wall thickness of 3/16 inch;
- c. Smooth plastic pipe, polyvinyl chloride (PVC), with a SDR of 26 or less or schedule 40 or heavier; or
- d. Corrugated profile wall (dual wall) polyethylene pipe (PE).

All plastic (PVC) and polyethylene pipe (PE) outlets shall include ultra-violet stabilizer. PVC or PE pipe outlets shall not be used where burning vegetation on the outlet ditch bank is likely to create a fire hazard.

The outlet shall be equipped with a flap-gate type rodent guard.

9. BLINDING

After the tubing or tile is placed in the excavated groove, friable material from the sides of the trench shall be placed around the tubing, completely filling the trench to a depth of not less than three inches over the top of the tubing. For material to be suitable it must not contain hard clods, rocks, frozen soil, or fine material which will cause a silting hazard to the drain. Tubing placed during any one day shall be blinded by the end of the day's work.

10. BACKFILLING

The backfilling of the trench shall be completed as rapidly as consistent with the soil conditions. Automatic backfilling machines may be used. Backfill shall extend above the ground surface and be well rounded over the trench.

Unless otherwise shown on the plans, in mineral soils, the minimum cover over subsurface drains shall be 2.4 feet. In organic soils, the minimum depth of cover after initial subsidence shall be 3.0 feet.

11. SPECIAL SPECIFICATIONS

A. Measurement and Payment

Compensation for any work item described in the contract documents but not listed in the bid schedule will be included in the payment for the item of work to which it is made subsidiary. Such items and bid items to which they are made subsidiary are identified in Items of Work and Construction Details section of this specification.

For items of work which lump sum prices are established in the contract, the quantity of work will not be measured for payment. Payment for each item will be made at the contract lump sum price and will constitute full compensation for completion of the work.

For items of work for which specific unit prices are established in the contract, the payment will be made based on the approved quantity measured by the engineer or weight tickets. Payment will constitute full compensation of the work completed as defined by each work item.

B. Items of Work and Construction Details

"Field Connections"

1. Bid Item No. 14

This item consists of intercepting existing district/field tile at locations shown on the plans for Site 8 and Site 22.

Field connections shall be made and encased in a Portland cement concrete (PCC) collar at least twelve (12) inches wide and four (4) inches thick, continuous around the joints. Alternative connections must be approved by the Engineer.

Measurement and payment for the Field Connections shall be a per Each item, and shall include all necessary fittings and adapters, watertight joints, excavation, and backfill.

“Tile Connection”

2. Bid Item No. 15

This item will consist of intercepting and rerouting JR1 tile for Site 21. This work shall also include capping and abandoning tile JR1 downstream of the connection.

Field connections shall be made and encased in a Portland cement concrete (PCC) collar at least twelve (12) inches wide and four (4) inches thick, continuous around the joints. Alternative connections must be approved by the Engineer.

Measurement and payment for the Tile Connection shall be a per Each item, and shall include all necessary fittings and adapters, watertight joints, excavation, and backfill.

“Fittings”

3. Bid Items No. 16 through 23

This item will consist of furnishing and installing the pipe fittings listed on the plans.

All other fittings not specifically listed on the plans shall be incidental to pipe installation or bid item.

“Piping”

4. Bid Items No. 24 through 33

This item will consist of furnishing and installing the type, material, size, and construction method of pipe at the locations shown on the plans. Open trench installation is required at the locations shown on the plans.

All tile connections are incidental to pipe installation unless otherwise noted on the plans.

The cleanouts shown on the plans for the bioreactors at Site 8 and Site 22 shall be paid as part of Bid Item No. 31. All appurtenances to install the cleanouts shall be incidental to this work.

The Fence Cut/Removal needed to install the saturated buffer distribution line for Site 6 shall be incidental to this item.

Measurement and payment for the piping shall be on an installed linear foot basis, and shall include all necessary fittings and adapters, watertight joints, excavation, and backfill.

Measurement and payment for the piping shall be on an installed linear foot basis, and shall include all necessary fittings and adapters, rodent guards, watertight joints, excavation, and backfill.

“8’x6” Cleanout”

5. Bid Item No. 52

This item will consist of furnishing and installing the cleanouts for the saturated buffer shown on the plans for Site 4.

All cleanouts for the bioreactors for Site 8 and Site 22 are paid under Item No. 31 and appurtenances are incidental to that work.

Measurement and payment for the 8'x6" Cleanouts shall be on a per Each basis and shall include all necessary fittings and adapters, watertight joints, excavation, and backfill.

Construction Specification

000 IA-51 Corrugated Metal Pipe Conduits

1. SCOPE

The work shall consist of furnishing and placing circular, arched or elliptical corrugated metal pipe and the necessary fittings.

2. MATERIALS

Metallic-coated steel corrugated pipe and fittings shall be zinc-coated or aluminized, Type 2, and shall conform to the requirements of ASTM A 760 and A 929 for the specified type and size of pipe. Aluminum corrugated pipe shall conform to the requirements of ASTM B 745 for the specified type and size of pipe. All pipe is subject to the following additional requirements:

1. When polymer coating is specified, pipe, coupling bands and anti-seep collars shall be coated in accordance with ASTM A 762. All riveted joints shall be caulked as described in paragraph B.
2. Pipe with annular corrugations shall be furnished with caulked seams. Riveted pipe joints shall be caulked with a bituminous mastic material during fabrication to provide a watertight joint. All circumferential and longitudinal seams shall be caulked before riveting. This shall be accomplished by applying a uniform bead of the mastic compound to the inner lap surface before riveting such that when the rivets are in place, all voids are filled and a coating of mastic is between the lap surfaces. The inner surface of coupling bands shall be asphalt coated in the field prior to installation. A neoprene gasket having a minimum thickness of 3/8 inch and a minimum width of 7 inches may be used in lieu of mastic coated coupling bands.
3. Welded or lock seams in helical corrugated pipe are considered to be watertight.
4. When close riveted pipe is specified: (1) the pipe shall be fabricated so that the rivet spacing in the circumferential seams shall not exceed 3 inches, except that 12 rivets will be sufficient to secure the circumferential seams in 12-inch pipe, and (2) in those portions of the longitudinal seams that will be covered by the coupling bands, the rivets shall have finished flat heads or the rivets and holes shall be omitted and the seams shall be connected by welding to provide a minimum of obstruction to the seating off the coupling bands.
5. Double riveting or double spot welding of pipe less than 42 inches in diameter may be required. If specified, the riveting or welding shall be done in the manner specified for pipe 42 inches or greater in diameter.

3. COUPLING BANDS

Coupling bands shall meet the requirements of the table below or have detailed drawings submitted for approval by the State Conservation Engineer. Coupling bands shall be of the same minimum thickness (gage) as the pipe being connected.

4. FABRICATION

Fabrication of all appurtenances shall be done as shown on the drawings. All appurtenances shall be made of metallic-coated steel when corrugated steel pipe is used and aluminum when used with aluminum pipe. Dissimilar metals shall not be installed in contact with each other.

Description of Coupling Band	Maximum Fill Height, Ft.	Maximum Pipe Diam., In.
24-inch wide coupling band with four 1/2-inch Diam. galvanized rods with tank lugs for annular or helical corrugated metal pipe. Bands shall have a minimum lap of 3 inches.	All	All
Hugger band from Armco Steel Corp. for helical corrugated metal pipe with reformed ends; and for annular corrugated pipe. Bands include O-ring gaskets and two 1/2-inch Diam.	35	48
Hugger band without rods and lugs but	20	24
Angles riveted or welded to a coupling band and drawn tight with bolts. Bands shall be a minimum of 7 corrugations wide and have a minimum lap of 2 inches.	35	15
Flanged couplings for helical corrugated 25 12 pipe welded to the ends of the pipe and field assembled by a minimum of 3/8-inch Diam. bolts. A joint sealer shall be placed between the flanges to ensure water tightness	25	12
1/ Use is limited to sites where soft foundation and conduit elongation is not anticipated.		

5. REPAIR OF DAMAGED COATINGS

The Contractor shall place the pipe without damaging the pipe or coatings. The pipe shall be transported and handled in a manner to prevent damage to the pipe or coating. Breaks, scuffs, or other damage to the various coatings shall be repaired as follows:

1. Metallic Coating - by thoroughly wire brushing the damaged area and cleaning with solvent, and then painting two coats of one of the following paints:
 - a. Zinc Dust - Zinc Oxide Primer conforming to ASTM D 79 and D 520.
 - b. Single package, moisture cured urethane prime in silver metallic color.
 - c. Zinc-rich cold galvanized compound, brush, or aerosol applications.
2. Polymer Coating - apply two coats of polymer material similar to and compatible with the durability, adhesion and appearance of the original polymer coating. The repair coating shall be a minimum thickness of 0.010 (10 mils) after drying and shall bond securely to the pipe.

6. LAYING AND BEDDING THE PIPE

The pipe shall be laid to the line and grade shown on the drawings and shall be firmly and uniformly bedded throughout its entire length. Details of the bedding are as shown on the drawings.

The pipe shall be laid with the outside laps of circumferential joints pointing upstream and with longitudinal laps on the sides at approximately the vertical mid-height of the pipe. Field welding of corrugated galvanized steel pipe will not be permitted. The pipe sections shall be joined with coupling bands.

7. BACKFILLING

Special care shall be taken during backfill operations not to disturb the grade and alignment.

The pipe shall be tied down or loaded sufficiently during backfilling around the sides to prevent its being lifted from the bedding.

Backfill material shall have sufficient moisture so that optimum compaction can be obtained. Backfill around the pipe shall be placed in layers not more than 4 inches thick before compaction.

Each layer of backfill shall be compacted with power tampers, hand tampers, or plate vibrators to the same density requirements as specified for the adjacent embankment. Backfill over and around the pipe shall be brought up uniformly on all sides. The passage of earth moving equipment will not be allowed over the pipe until backfill has been placed above the top of the pipe surface to a depth of two (2) feet.

8. SPECIFIC SITE REQUIREMENTS

A. Measurement and Payment

Compensation for any work item described in the contract documents but not listed in the bid schedule will be included in the payment for the item of work to which it is made subsidiary. Such items and bid items to which they are made subsidiary are identified in Items of Work and Construction Details section of this specification.

For items of work which lump sum prices are established in the contract, the quantity of work will not be measured for payment. Payment for each item will be made at the contract lump sum price and will constitute full compensation for completion of the work.

For items of work for which specific unit prices are established in the contract, the payment will be made based on the approved quantity measured by the engineer or weight tickets. Payment will constitute full compensation of the work completed as defined by each work item.

B. Items of Work and Construction Details

“CMP Tile Extensions/Outlets”:

1. Bid Item No. 34 through 37

This item will consist of furnishing and installing the CMP tile extension outlet pipes and fittings shown on the plans for tile outlets, including animal guard at outlet end of pipe.

All tile connections are incidental to pipe installation unless otherwise noted on the plans.

The corrugated metal pipe shall be 16-gauge minimum, zinc coated or aluminum coated with annular or helical corrugations.

Connect dissimilar pipes with manufactured adapters or couplings if available. A concrete collar shall be used as shown on the plans. Connections shall be watertight.

Installation shall be so at least two-thirds of the outlet pipe shall be buried in the ditch bank, and the cantilever section must extend to the toe of the ditch side slope or the side slope protected from erosion.

Measurement and payment shall be on an installed foot basis - including all necessary fittings and adapters rodent guards, watertight joints, excavation, and backfill - will constitute full compensation for this bid item and related subsidiary items.

Payment will constitute full compensation for the following related items: Pollution Control, and Animal Guard.

2. Subsidiary Item - CMP Animal Guard

This item will consist of furnishing and installing the CMP animal guard, for each size tile such as AgriDrain RG series or Engineer approved equal.

No separate payment will be made for the CMP animal guard. Compensation for this item shall be included in the payment for CRCS and CMP tile outlet pipes.

3. Subsidiary Item - Corrugated Metal Water-tight Coupling Bands

This item will consist of furnishing and installing the corrugated metal coupling bands for connections of all pipe sections.

No separate payment will be made for the CMP coupling bands. Compensation for this item shall be included in the payment for CMP metal outlet pipe.

Construction Specification

000 IA-95 Geotextile

1. SCOPE

This work shall consist of furnishing all materials, equipment, and labor necessary for the installation of geotextile.

2. MATERIAL QUALITY

Geotextile shall be manufactured from synthetic long chain or continuous polymeric filaments or yarns, having a composition of at least 95 percent, by weight, of polypropylene, polyester or polyvinylidene chloride. The geotextile shall be formed into a stable network of filaments or yarns that retain their relative position to each other, are inert to commonly encountered chemicals and are resistant to ultraviolet light, heat, hydrocarbons, mildew, rodents and insects. Unless otherwise specified, the class and type of geotextile shall be as shown on the drawings and shall meet the requirements for materials that follow:

1. Woven Geotextile shall conform to the physical properties listed in Table 1. The woven geotextile shall be manufactured from monofilament yarns that are woven into a uniform pattern with distinct and measurable openings. The geotextile shall be manufactured so that the yarns will retain their relative position with regard to each other. The yarns shall contain stabilizers and/or inhibitors to enhance their resistance to ultraviolet light or heat exposure. The edges of the material shall be salvaged or otherwise finished to prevent the outer yarn from unraveling.
2. Nonwoven Geotextile shall conform to the physical properties listed in Table 2. Nonwoven geotextile shall be manufactured from randomly oriented fibers that have been mechanically bonded together by the needle-punched process. In addition, one side may be slightly heat bonded. Thermally bonded, nonwoven geotextile, in addition to mechanically bonded, nonwoven geotextile, may be used for Road Stabilization. The filaments shall contain stabilizers and/or inhibitors to enhance their resistance to ultraviolet light or heat exposure.
3. The geotextile shall be shipped in rolls wrapped with a protective covering to keep out mud, dirt, dust, debris and direct sunlight. Each roll of geotextile shall be clearly marked to identify the brand, type and production run.

3. STORAGE

Prior to use, the geotextile shall be stored in a clean dry place, out of direct sunlight, not subject to extremes of either hot or cold, and with the manufacturer's protective cover in place. Receiving, storage, and handling at the job site shall be in accordance with the requirements in ASTM D 4873.

4. SURFACE PREPARATION

The surface on which the geotextile is to be placed shall be graded to the neat lines and grades as shown on the drawings. The surface shall be reasonably smooth and free of loose rock and clods, holes, depressions, projections, muddy conditions and standing or flowing water (unless otherwise shown on the drawings).

5. PLACEMENT

Prior to placement of the geotextile, the soil surface will be inspected for quality assurance of design and construction. The geotextile shall be placed on the approved prepared surface at the locations and in accordance with the details shown on the drawings. The geotextile shall be unrolled along the placement area and loosely laid (not stretched) in such a manner that it will conform to the surface irregularities

when material is placed on or against it. The geotextile may be folded and overlapped to permit proper placement in the designated area.

The geotextile shall be joined by overlapping a minimum of 18 inches (unless otherwise specified), and secured against the underlying foundation material. Securing pins, approved and provided by the geotextile manufacturer, shall be placed along the edge of the panel or roll material to adequately hold it in place during installation. Pins shall be steel or fiberglass formed as a “U”, “L”, or “T” shape or contain “ears” to prevent total penetration. Steel washers shall be provided on all but the “U” shaped pins. The upstream or up-slope geotextile shall overlap the abutting down-slope geotextile. At vertical laps, securing Natural Resources Conservation Service pins shall be inserted through both layers along a line through approximately the midpoint of the overlap. At horizontal laps and across slope laps, securing pins shall be inserted through the bottom layer only. Securing pins shall be placed along a line approximately 2 inches in from edge of the of the placed geotextile at intervals not to exceed 12 feet unless otherwise specified. Additional pins shall be installed as necessary and where appropriate, to prevent any undue slippage or movement of the geotextile. The use of securing pins will be held to the minimum necessary. Pins are to be left in place unless otherwise specified.

Should the geotextile be torn or punctured, or the overlaps disturbed, as evidenced by visible geotextile damage, subgrade pumping, intrusion, or grade distortion, the backfill around the damaged or displaced area shall be removed and restored to the original approved condition. The repair shall consist of a patch of the same type of geotextile being used, overlaying the existing geotextile. The patch shall extend a minimum of 2 feet from the edge of any damaged area.

The geotextile shall not be placed until it can be anchored and protected with the specified covering within 48 hours or protected from exposure to ultraviolet light. Geotextile shall be placed in accordance with the following applicable specification according to the use indicated in drawings:

Slope protection – Class I or II as indicated in Tables 1 and 2.

The geotextile shall not be placed until it can be anchored and protected with the specified covering within 48 hours or protected from exposure to ultraviolet light. Rock shall not be pushed or rolled over the geotextile.

Class I, unprotected – limit height for dropping stone onto bare geotextile to 3 feet.

Class II, protected – require the use of 6 inches a clean pit-run gravel over the geotextile to cushion the stone and limit the height of drop to 3 feet.

On slopes with strong seepage flow, the geotextile must be in intimate contact with the soil to prevent erosion of the soil surface. Use 6 inches of a clean pit-run gravel over the geotextile to hold it in place and minimize voids under the riprap. Embedment of the geotextile in a trench to form a cutoff at regular intervals down the slope will prevent erosion under the fabric. Place cutoffs more closely together in highly erodible soils and wider apart in more stable soils

Subsurface drains – Class III as indicated in Tables 1 and 2.

The geotextile shall not be placed until drainfill or other material can be used to provide cover within the same working day. Drainfill material shall be placed in a manner that prevents damage to the geotextile. In no case shall material be dropped on uncovered geotextile from a height of more than 5 feet.

Road stabilization – Class IV as indicated in Tables 1 and 2.

The geotextile shall be unrolled in a direction parallel to the roadway centerline in a loose manner permitting conformation to the surface irregularities when the roadway fill material is placed on its surface. In no case shall material be dropped on uncovered geotextile from a height of more than 5 feet. Unless otherwise specified, the minimum overlap of geotextile panels joined without sewing shall be 24 inches.

The geotextile may be temporarily secured with pins recommended or provided by the manufacturer, but they shall be removed before the permanent covering material is placed.

Table 1. Requirements for Woven Geotextiles^{1/}

Property	Test Method	Class I	Class II	Class III	Class IV
Grab tensile strength (pounds)	ASTM D4632	247 minimum	180 minimum	180 minimum	315 minimum
Elongation at failure (%)	ASTM D4632	< 50	< 50	< 50	< 50
Trapezoidal tear strength (pounds)	ASTM D4533	90 minimum	67 minimum	67 minimum	112 minimum
Puncture strength (pounds)	ASTM D6241	495 minimum	371 minimum	371 minimum	618 minimum
Ultraviolet light (% retained strength)	ASTM D4355	50 minimum	50 minimum	50 minimum	70 minimum
Permittivity (sec ⁻¹)	ASTM D4491	as specified			
Apparent opening size (AOS) ^{2/}	ASTM D4751	as specified			
Percent open area (POA)(%)	USACE ^{3/} CWO-02215-86	as specified			

^{1/} All values are minimum average roll values (MARV) in the weakest principal direction, unless otherwise noted.

^{2/} Maximum average roll value.

^{3/} Note: CWO is a USACE reference.

Table 2. Requirements for Nonwoven Geotextiles^{1/}

Property	Test Method	Class I ^{2/}	Class II ^{2/}	Class III ^{2/}	Class IV ^{2/}
Grab tensile strength (pounds)	ASTM D4632 grab test	202 minimum	157 minimum	112 minimum	202 minimum
Elongation at failure (%)	ASTM D4632	50 minimum	50 minimum	50 minimum	50 minimum
Trapezoidal tear strength (pounds)	ASTM D4533	79 minimum	56 minimum	40 minimum	79 minimum
Puncture strength (pounds)	ASTM D6241	433 minimum	309 minimum	223 minimum	433 minimum
Ultraviolet light (% retained strength)	ASTM D4355	50 minimum	50 minimum	50 minimum	50 minimum
Permittivity (sec ⁻¹)	ASTM D4491	0.7 minimum or as specified			
Apparent opening size (AOS) ^{3/}	ASTM D4751	0.22 minimum or as specified			

^{1/} All values are minimum average roll values (MARV) in the weakest principal direction, unless otherwise noted.

^{2/} Needle punched geotextiles may be used for all classes. Heat-bonded or resin-bonded geotextiles may be used for class IV only.

^{3/} Maximum average roll value.

6. SPECIFIC SITE REQUIREMENTS

A. Measurement and Payment

Compensation for any work item described in the contract documents but not listed in the bid schedule will be included in the payment for the item of work to which it is made subsidiary. Such items and bid items to which they are made subsidiary are identified in Items of Work and Construction Details section of this specification.

For items of work which lump sum prices are established in the contract, the quantity of work will not be measured for payment. Payment for each item will be made at the contract lump sum price and will constitute full compensation for completion of the work.

For items of work for which specific unit prices are established in the contract, the payment will be made based on the approved quantity measured by the engineer or weight tickets. Payment will constitute full compensation of the work completed as defined by each work item.

B. Items of Work and Construction Details

“Class II Nonwoven Geotextile Fabric (Type IV)”:

1. Bid Item No. 12

This item will consist of furnishing and installing the geotextile fabric to separate the wood chips from the soil cap as noted on the locations in the plans.

Overlap joints of geotextile fabric a minimum of 18 inches.

Measurement and payment shall be on an square yard basis for surface area covered and will constitute full compensation for this bid item and related subsidiary items.

Practice Specification Saturated Buffer (Code 604)

SCOPE

The work consists of furnishing materials, installing all components, and performing all clearing and grubbing, excavations, grading, and earthfill required to construct the Saturated Buffer as shown on the plans or as staked in the field.

It is the Landowner's responsibility to locate any existing subsurface drains that may be under, along, or crossing the saturated buffer prior to construction. The NRCS is not responsible for any subsurface drains damaged during construction.

MATERIALS

Earth materials used in backfilling around the structure and pipe must be suitable material obtained from excavated material or from other approved sources as shown on the plans, described in Section 8, or approved by the Inspector. The fill material must be free from brush, roots, frozen material, sod, stones over 6 inches in diameter, or other undesirable material.

All disturbed areas must be finished so they are suitable for the planned use after construction is completed. If needed, stockpile topsoil and spread over excavations and other areas to facilitate establishment of vegetation.

Pipe, pipe sizes, fittings, and other appurtenances must be as specified on the plans. These items must conform to the "materials" section of Practice Specification IA-620, Underground Outlet, or as shown in Section 8 of this specification.

Structures must be fabricated and installed as shown on the plans. Structures must be of durable material, structurally sound, and resistant to damage by rodents or other animals. Structures must be of rigid material which does not require supplemental support to remain in a vertical position. Materials which meet these requirements include the following:

1. Corrugated metal pipe, galvanized or aluminum, 16 gauge minimum,
2. Smooth steel pipe, with 3/16-inch minimum wall thickness,
3. Smooth plastic pipe, polyvinyl chloride (PVC), with an SDR of 43 or less,
4. High-density polyethylene pipe (PE). Round pipe shall have an SDR of 43 or less. Square intakes shall have minimum wall thickness as shown in the following table:

Square PE Intake

Nominal Size	Maximum Thickness
6 inch	0.16 inch
8 inch	0.21 inch
10 inch	0.26 inch
12 inch	0.31 inch

All plastic and polyethylene structures must include ultra-violet stabilizer to protect them from solar degradation.

Appurtenances (i.e. tees and elbows) for polyvinyl chloride (PVC) inlets must be schedule 40 or heavier.

EXCAVATION

Remove all trees, stumps, roots, brush, and other undesirable materials from the work area as shown on the plans or as agreed upon with the Landowner and Inspector. Burning of trees and brush must comply with all applicable state and local regulations.

Cuts and fills should be made in such a manner that topography will be enhanced. Excess spoil material must be placed, spread, leveled, shaped, or hauled away as shown on the plans or as staked in the field.

All excavations must conform to the lines, grades, elevations, bottom width, and side slopes shown on the construction plans or as staked in the field. The conduit trench bottom must be smooth and free of exposed rock. If rock is encountered in the trench bottom, over-excavate the trench and place at least 6 inches of compacted fill or sand bedding in the trench to bring it up to the conduit grade.

If not otherwise shown on the plans, trench width at the top of the conduit must have a minimum clearance of 3 inches from outside edge of the conduit. The trench width at the top of the conduit must have a maximum clearance of 6 inches from the outside edge of the conduit unless an approved bedding material is used.

Plow installation is allowed. The minimum trench width must be 2 inches wider than the conduit on each side. Grade control and bedding conditions must be closely monitored during the plow installation.

All excavation for structure installation must be sloped to no steeper than 2:1.

STRUCTURE INSTALLATION

Install structures according to the lines, grades, and elevations shown on the plans and as staked in the field. Prefabricated structures must be handled in accordance with manufacturer recommendations to ensure the structure's integrity after installation.

Place backfill around the structure in 9-inch lifts and hand compacted. The moisture content of the fill material must be such that a ball formed with the hands does not crack or separate when struck sharply with a pencil and will easily ribbon out between the thumb and finger.

The finished surfaces must present a workmanlike appearance.

PIPE INSTALLATION

Install pipe as shown on the plans and/or as staked in the field.

Unless otherwise specified, no filter or envelope is required around the distribution pipe. In stable soils, shape the bottom of the trench to form a semicircular, trapezoidal, or 90-degree "V" groove in its center. Shape the groove to fit the size of tile. The 90-degree "V" groove must not be used on conduits greater than 6 inches in diameter.

If the bottom of the trench does not provide a sufficiently stable or firm foundation for the distribution pipe, use a sand-gravel mix or other approved material to stabilize the bottom of the trench.

When a filter is specified, the shape of the bottom of the trench and the gradation and thickness of the filter or envelope material to be placed around the conduit will be as shown on the plans. Place the filter or envelope material in the bottom of the trench. Install the conduit as shown on the plans. Place the filter or envelope material over the conduit.

The slope of the distribution lines is critical. Extra care must be taken to ensure that these lines are laid on a uniform grade throughout the length of the line or as shown on the plans. Anchor the pipe or place a vertical load on it, while exposed, at regular intervals to prevent uplift and separation from the bedding during backfill. Backfill the trench above the ground surface and round the top of the earthfill over the trench.

The minimum depth of backfill over the distribution conduit is 2.4 feet.

Make lateral connections with manufactured appurtenances (wyes, tees, couplings, etc.) comparable in strength and durability with the type of conduit being used. Pipe connections to the structure must be watertight.

OUTLET

Use a continuous section of non-perforated conduit at least 20 feet long at the outlet. Bury at least two-thirds of the outlet pipe in the ditch bank with the end of the pipe placed above the toe of the ditch, or protect the side slope from potential erosion due to discharge of the pipe. Acceptable materials for use of the outlet conduit include the following:

1. Corrugated metal pipe, galvanized or aluminum, 16 gauge minimum;
2. Smooth steel pipe with a minimum wall thickness of 3/16 inch;
3. Smooth plastic pipe, polyvinyl chloride (PVC), with a SDR of 26 or less or schedule 40 or heavier;
or
4. Corrugated profile wall (dual wall) polyethylene pipe (PE).

All plastic (PVC) and polyethylene pipe (PE) outlets must include ultra-violet stabilizer. Do not use PVC and PE pipe outlets where vegetation on the ditch bank may be burned and will likely damage the pipe.

All outlet pipes must have a flap-gate type animal guard.

SEEDING

Establish a protective cover of vegetation on the entire soil saturation area and all surfaces disturbed by construction as shown on the plans or staked in the field. Plant species must be water tolerant and suitable for wet soil conditions. Seeding and mulching must be performed in accordance with the IA-CPA-4, Seeding Plan, and Construction Specification IA-6, Seeding and Mulching for Protective Cover.

Specific Site Requirements

A. Measurement and Payment

Compensation for any work item described in the contract documents but not listed in the bid schedule will be included in the payment for the item of work to which it is made subsidiary. Such items and bid items to which they are made subsidiary are identified in Items of Work and Construction Details section of this specification.

For items of work which lump sum prices are established in the contract, the quantity of work will not be measured for payment. Payment for each item will be made at the contract lump sum price and will constitute full compensation for completion of the work.

For items of work for which specific unit prices are established in the contract, the payment will be made based on the approved quantity measured by the engineer or weight tickets. Payment will constitute full compensation of the work completed as defined by each work item.

B. Items of Work and Construction Details

This Practice Specification covers multiple items included in the project. The Contractor shall confirm construction of the saturated buffer is consistent between this Practice Specification and other specifications included as part of the project. Any discrepancies shall be brought to the attention of the Engineer.

For the water control structures, the bid item(s) shall include furnishing and installing the water control structures at the locations shown on the plans. The plans list the required dimensions for each water control structure. Incidental to this bid item are all appurtenances necessary to meet the plans and specs, including, but not limited to, stable base, couplers, stop boards, stop board removal tool, and structure lid with locking mechanism. Contractor shall provide detailed shop drawings of the water control structures and all appurtenances. Measurement and payment for the water control structure shall be a per Each item shall also include all necessary fittings and adapters, watertight joints, excavation, and backfill. Measurement and payment for the water control structure shall be a per Each item shall also include all necessary fittings and adapters, watertight joints, excavation, and backfill.

Fiberglass marking flags used to mark the location of the water control structures shall be paid under Bid Item No. 5. Flags shall be at least 6 feet tall and have a rod diameter greater than or equal to 5/16".

Measurement and payment for the flags shall be a per Each item.

Practice Specification Denitrifying Bioreactor (Code 605)

SCOPE

The work consists of constructing a denitrifying bioreactor as required by the construction plans.

UTILITIES

The contractor is responsible for calling Iowa One Call at least 48 hours prior to beginning any excavation work. The landowner is responsible for locating other infrastructure such as tile lines and structures. The landowner will obtain all necessary permissions from regulatory agencies, or document that no permits are required.

GENERAL

Carry out construction operations in a manner and sequence that erosion and air and water pollution are minimized and held within legal limits.

The completed job must present a workmanlike appearance and conform to the line, grades, and elevations shown on the drawings or as staked in the field.

Carry out all operations in a safe and skillful manner. Observe safety and health regulations and use appropriate safety measures.

Save documentation of materials used (geotextile tags, seed tags, photographs of pipe labeling, etc.) and provide to NRCS.

Remove all trees, stumps, brush, and debris from the site and disposed of so they will not interfere with construction or proper functioning of the structure.

EXCAVATION

Unless otherwise specified, begin excavation for and subsequent installation of the pipe and structures at the outlet end and progress upstream.

Excess spoil material must be placed, spread, leveled, shaped, or hauled away as shown on the construction plans or as staked in the field. Finish the completed job to a degree so the surface can be traveled with farm-type equipment unless otherwise specified in the construction plans.

All excavations must conform to the lines, grades, elevations, bottom width, and side slopes shown on the construction plans or as staked in the field.

Trench shields, shoring, bracing, or other methods necessary to safeguard the workers and prevent damage to the existing improvements shall be furnished, placed, and subsequently removed by the contractor. Occupational Safety and Health Administration (OSHA) requirements relating to trench safety shall be followed.

MEDIA CHAMBER

Line the bottom and sides of the media chamber with plastic as shown on the construction drawings. Plastic must have a minimum thickness of 4 mil.

If a soil cap is to be constructed over the top of the chamber, use geotextile to separate the media from the soil. Geotextile must be non-woven, class II, and meet the requirements of Iowa Construction Specification IA-95, Geotextile.

Carbon source media must meet the following requirements:

1. Wood material must be chipped, not shredded. At minimum, 90% of the chips by weight must be 1-inch to 2-inch in length (longest direction).
2. Wood chips must be free from objectionable material such as dirt, fines, stones, leaves, long stringy material, etc. Decomposed or partially decomposed wood chips shall not be used.
3. Wood must not be treated for ground contact.

4. Wood made from high tannin content species such as oak, cedar, or redwood is to be avoided. NRCS will reject any proposed wood chips with more than 50% by volume oak wood chip materials. The contractor is advised to check with NRCS in advance for acceptance of the media to be used in the bioreactor.

Spread the media evenly around the chamber. There must be no air pockets, bridging, or uneven surface of the media. Media must be placed in a manner that avoids damage to the distribution and collection pipes in the chamber.

Mound the top surface of the media chamber with the material specified in the plans to allow for settlement of the media and to shed water. Mound the center of the trench as shown on the plans but no less than 10% of the total depth of the media material.

WATER CONTROL STRUCTURE AND PIPE

The materials and manufacture of the water control structure, pipe, anti-seep collars, coupling bands, coatings, and other appurtenances must be as shown on the construction drawings and conform to materials and applicable reference specifications as shown in Iowa Construction Specification IA-620, Underground Outlet.

Place the water control structure and pipe couplers on a stable base. The stable base may be compacted earth, compacted sand, or a concrete pad. Extend the stable base no less than 1 foot around the structure.

Install the structure with all stop boards in their tracks. Place impervious backfill material around the structure and appurtenances by hand and in layers not more than 6 inches thick before compaction. Thoroughly compact each layer, by means of hand tamping, to the same density as the surrounding materials. Increase the height of fill at approximately the same rate on all sides of the structure.

Lay the pipe to the lines, grades, and elevations shown on the drawings. Bed the pipe firmly and uniformly throughout its entire length. Use hand tamping methods around pipes that are within 20 feet of the water control structure. Beyond that distance, the pipe may be laid with a tile plow or trencher designed for proper bedding of the pipe, and the disturbed soil allowed to naturally subside back into place.

OUTLET

Where the construction plans call for a free outlet, use a continuous section of non-perforated conduit at the outlet, unless a headwall is used. All outlets must have an animal guard, installed to allow passage of debris.

The continuous section of non-perforated conduit must be long enough to satisfy all requirements of Conservation Practice Standard 606 – Subsurface Drain:

- At least two-thirds of the pipe must be buried in the ditch bank.
- The cantilever section must extend to the toe of the ditch side slope or to the side slope protected from erosion.
- The continuous section must be at least 20 feet long.

Acceptable materials for use at the outlet include the following:

- Corrugated metal pipe, galvanized or aluminum, 16-gauge, minimum thickness,
- Smooth steel pipe with 3/16 of an inch minimum thickness,
- Smooth plastic pipe, polyvinyl chloride (PVC), with a SDR of 35 or less or schedule 40 or heavier, and
- Dual wall corrugated polyethylene pipe.

All plastic and polyethylene pipe outlets must include an ultra-violet stabilizer.

VEGETATION

Establish a protective cover of vegetation on all surfaces of the areas disturbed by construction. Perform seeding and mulching in accordance with the Seeding Plan, IA-CPA-4, and Construction Specification IA-6, Seeding and Mulching for Protective Cover.

Establish vegetation as soon after construction as possible.

Specific Site Requirements

A. Measurement and Payment

Compensation for any work item described in the contract documents but not listed in the bid schedule will be included in the payment for the item of work to which it is made subsidiary. Such items and bid items to which they are made subsidiary are identified in Items of Work and Construction Details section of this specification.

For items of work which lump sum prices are established in the contract, the quantity of work will not be measured for payment. Payment for each item will be made at the contract lump sum price and will constitute full compensation for completion of the work.

For items of work for which specific unit prices are established in the contract, the payment will be made based on the approved quantity measured by the engineer or weight tickets. Payment will constitute full compensation of the work completed as defined by each work item.

B. Items of Work and Construction Details

This Practice Specification covers multiple items included in the project. The Contractor shall confirm construction of the saturated buffer is consistent between this Practice Specification and other specifications included as part of the project. Any discrepancies shall be brought to the attention of the Engineer.

For the water control structures, the bid item(s) shall include furnishing and installing the water control structures at the locations shown on the plans. The plans list the required dimensions for each water control structure. Incidental to this bid item are all appurtenances necessary to meet the plans and specs, including, but not limited to, stable base, couplers, stop boards (including v-notch stop board for outlet WCS), stop board removal tool, and structure lid with locking mechanism. Contractor shall provide detailed shop drawings of the water control structures and all appurtenances. Measurement and payment for the water control structure shall be a per Each item shall also include all necessary fittings and adapters, watertight joints, excavation, and backfill.

Woodchips for the bioreactors shall be paid under Bid Item No. 10 and shall meet the requirements listed above. The plans list additional information regarding installation of the woodchips. Measurement and payment for the woodchips will be per cubic yard shall include all hauling and placement. No field measurement shall be made. Dispute of quantities shall only be considered with the supplier's written means and methods of measurement. Measurement based on trailer dimensions is not acceptable.

The Impermeable Plastic Liner (4 mil) used to line the bioreactor pit/chamber shall be paid under Bid Item No. 11 and should be installed at the locations shown on the plans. The liner shall be secured to the sidewalls of the bioreactor pit/chamber using manufacture approved staples. Overlap the joints of the liner a minimum of 18" but do not lay the liner over top of the media chamber. Measurement and payment for the liner will be per square yard of area covered per plan quantity shall include all furnishing and installation. No field measurement shall be made.

Fiberglass marking flags used to mark the location of the water control structures and the corners of the bioreactors shall be paid under Bid Item No. 5. Flags shall be at least 6 feet tall and have a rod diameter greater than or equal to 5/16". Measurement and payment for the flags shall be a per Each item.

Practice Specification Underground Outlet (Code 620)

SCOPE

This work consists of installation of underground outlets and any appurtenant water control structures in accordance with an approved plan and design.

MATERIALS

Materials for underground outlets must meet the requirements as shown in the plans and specifications. They must be field inspected for any deficiencies such as thin spots or cracking prior to installation.

Conduit

The following reference specifications pertain to products currently acceptable for use as underground outlets:

Plastic Pipe

3 through 24 inch Corrugated Polyethylene (PE) Pipe and Fittings	ASTM F667
12 to 60 in. Annular Corrugated Profile-Wall Polyethylene (PE) Pipe	ASTM F2306
2 to 60 in. Annular Corrugated Profile Wall Polyethylene (PE) Pipe	ASTM F2648
3 to 24 in. Lined Flexible Corrugated Polyethylene Pipe	ASTM F3390
Poly (Vinyl Chloride) (PVC) Corrugated Sewer Pipe With a Smooth Interior and Fittings (4-36 inch)	ASTM F949
Poly (Vinyl Chloride) (PVC) Sewer Pipe and Fittings	ASTM D2729
Type PSM Poly (Vinyl Chloride) (PVC) Sewer Pipe and Fittings	ASTM D3034
Poly (Vinyl Chloride) (PVC) Plastic Pipe (Sch Series)	ASTM D1785
Poly (Vinyl Chloride) (PVC) Pressure-Rated Pipe (SDR Series)	ASTM D 2241

Clay Pipe

Clay Drain Tile	ASTM C4
Vitrified Clay Pipe, Extra Strength, Standard Strength and Perforated	ASTM C700

Concrete Pipe

Concrete Drain Tile (4-36 inch)	ASTM C412
Concrete Pipe for Irrigation or Drainage	ASTM C118
Nonreinforced Concrete Sewer, Storm Drain and Culvert Pipe	ASTM C14
Reinforced Concrete Culvert, Storm Drain and Sewer Pipe	ASTM C76
Perforated Concrete Pipe	ASTM C444

Other Pipe

Styrene-Rubber (SR) Plastic Drain Pipe and Fittings	ASTM D2852
Corrugated Aluminum Pipe for Sewers and Drains	ASTM B745
Corrugated Steel Pipe, Metallic-Coated for Sewers and Drains	ASTM A760

Inlet

Fabricate and install the inlet as shown on the plans. Inlets must be of durable material, structurally sound, and resistant to damage by rodents or other animals. Inlets must be of rigid material, which does not require supplemental support to remain in a vertical position. Materials, which meet these requirements, include the following:

1. Corrugated metal pipe, galvanized or aluminum, 16 gauge minimum,
2. Smooth steel pipe, with 3/16-inch minimum wall thickness,
3. Smooth plastic pipe, polyvinyl chloride (PVC), with an SDR of 43 or less,
4. High-density polyethylene pipe (PE). Round pipe shall have an SDR of 43 or less. Square intakes shall have minimum wall thickness as shown in the following table:

Square Intake Wall Thickness

Nominal Size	Minimum Thickness
6 inch	0.16 inch
8 inch	0.21 inch
10 inch	0.26 inch
12 inch	0.31 inch

All plastic and polyethylene inlets must include ultra-violet stabilizer to protect from solar degradation.

Perforations in the inlet must be smooth and free of burrs. Unless otherwise specified, the above ground portion of the inlet will have holes evenly spaced around the perimeter of the inlet in accordance with the following table:

Minimum Number of Holes

Inlet Size	Minimum Number of 1" Diameter Holes per Foot of Inlet
4 inch	20
5 inch	24
6 inch	30
8 inch	40
10 inch	50
12 inch	60

If slots or round holes other than 1 inch in diameter are provided, the total cross sectional area of the openings per foot will be equivalent to that provided by 1 inch diameter round holes meeting the above criteria.

The below ground portion of the inlet may be perforated with holes 5/16-inch in diameter or less to provide drainage around the inlet.

Appurtenances (i.e. tees and elbows) for polyvinyl chloride (PVC) inlets must be schedule 40 or heavier.

Additional subsurface drainage tubing or tile may be used in conjunction with the surface inlet to improve access and farmability around the inlet. These underground extensions (when used) will have a minimum length of 10 feet.

The inlet must be offset from the main conduit except as noted below. A minimum of 8 feet of non-perforated conduit will be installed between the inlet and the main conduit. The minimum diameter of the offset line is 3 inches. When conduit capacity is based on orifice flow from the inlet, fabricate the inlet so that an orifice can easily be installed.

Only the top inlet in a terrace system may be placed directly on the main conduit. If the topmost inlet in a terrace system is placed directly on the main conduit, the conduit must be non-perforated from the inlet to the toe of the terrace back slope.

Outlet

Use a continuous section of non-perforated conduit at least 20 feet long at the outlet. Two-thirds of the outlet pipe must be buried in the ditch bank, and the cantilever section must extend to the toe of the ditch side slope or protect the side slope from erosion. Acceptable materials for use at the outlet include the following:

1. Corrugated metal pipe, galvanized or aluminum, 16 gauge minimum;
2. Smooth steel pipe, with 3/16-inch minimum wall thickness;
3. Smooth plastic pipe, polyvinyl chloride (PVC), with a SDR of 26 or less or schedule 40 or heavier; or
4. Corrugated profile wall (dual wall) polyethylene (PE) pipe meeting or exceeding the requirements of ASTM F 2648 (2" to 60"), ASTM F 2306 (12" to 60"). Pipe conforming to AASHTO M 252 (3" to 10"), or AASHTO M 294 (12" to 60") is acceptable.

All plastic and polyethylene pipe outlets must include ultra-violet stabilizer. PVC and PE pipe outlets must not be used where burning vegetation on the outlet ditch bank is likely to create a fire hazard.

Connections with the outlet pipe must be made watertight.

Equip the outlet with a flap gate rodent guard.

TRENCH EXCAVATION

Trench excavation must be sufficient to provide required cover after other construction is completed.

The trench bottom will be smooth and free of exposed rock. If rock is encountered in the trench bottom, over-excavate the trench and place at least 6 inches of compacted earth or sand bedding in the trench to bring it up to the conduit grade. In stable soils, shape the bottom of the trench to form a semicircular, trapezoidal, or 90-degree "V" groove in its center. Shape the groove to fit the size of conduit. Do not use the 90-degree "V" groove on conduits greater than 6 inches in diameter.

Unless otherwise shown on the drawings, use a trench width at the top of the conduit the minimum required to permit installation and provide bedding conditions suitable to support the load on the conduit, but with not less than 3 inches of clearance on each side. Use a maximum trench width of the conduit diameter plus 12 inches measured at the top of the conduit, unless approved bedding is installed.

Plow installation is allowed except under the base width of the terrace or embankment. Trench width will be at least two (2) inches wider than the conduit on each side to allow sufficient bedding to support the pipe.

INSTALLATION

Install the underground outlet system to the line and grade shown in the plans or as staked in the field. Install and properly blind or bed conduit lines prior to placement of any other earthfill over the lines.

Join conduit lines with standard factory couplers, if applicable, to produce a continuous system. Use internal couplers if they do not cause excessive flow restrictions. Protect conduit ends during installation.

Install all appurtenant structures, including trash and rodent guards, promptly and make provisions for protecting them during installation. Cap all conduit ends except the outlet and inlets with screens with standard factory end caps or concrete. When corrugated plastic tubing is used, no more than 5% stretch will be allowed.

Orifice plates, when specified, must have smooth edges and fit tightly.

TRENCH BACKFILL

Bed and backfill conduits throughout the base width of the basin embankment or terrace ridge. Place friable soil material in 4 inch layers and hand tamped to a depth of 2 feet above the conduit. Slope the sides of the remaining trench no steeper than 3 horizontal to 1 vertical and place backfill in 9 inch layers and machine compacted.

Water packing may be used as an alternative to mechanical compaction. If the conduit is non-perforated, fill it with water during the water packing procedure. The initial backfill, before wetting, must be of sufficient depth to ensure complete coverage of the pipe after consolidation has taken place. Perform water packing by adding water in such quantity as to thoroughly saturate the initial backfill without inundation. Allow the wetted fill to dry until firm before final backfill is begun. Perform final backfill by placing friable soil material in 4 inch layers and hand tamping to a depth of 2 feet above the conduit.

Slope the sides of the remaining trench no steeper than 3 horizontal to 1 vertical and backfill placed in 9 inch layers and machine compacted.

Backfill conduit which is not under the embankment or terrace ridge with select bedding material containing no hard objects larger than 1½ inches in diameter to a minimum depth of 6 inches over the conduit. Hold the conduit in place mechanically while select backfill material is placed around and over the conduit. This is to ensure that the proper conduit grade is maintained. Place all backfill material so that deflection or displacement of the conduit will not occur. Backfill the remainder of the trench above the conduit as rapidly as consistent with the soil conditions. Extend backfill above the ground surface and be well rounded over the trench. Large stones, frozen material, and large clods are not allowed in the backfill material.

FINISH

Smooth work areas and leave in a workmanlike manner. Establish vegetation or other protective cover as specified.

Specific Site Requirements

A. Measurement and Payment

Compensation for any work item described in the contract documents but not listed in the bid schedule will be included in the payment for the item of work to which it is made subsidiary. Such items and bid items to which they are made subsidiary are identified in Items of Work and Construction Details section of this specification.

For items of work which lump sum prices are established in the contract, the quantity of work will not be measured for payment. Payment for each item will be made at the contract lump sum price and will constitute full compensation for completion of the work.

For items of work for which specific unit prices are established in the contract, the payment will be made based on the approved quantity measured by the engineer or weight tickets. Payment will constitute full compensation of the work completed as defined by each work item.

B. Items of Work and Construction Details

This Practice Specification covers multiple items included in the project. The Contractor shall confirm construction of the saturated buffer is consistent between this Practice Specification and other specifications included as part of the project. Any discrepancies shall be brought to the attention of the Engineer.

CONSTRUCTION INSPECTION PLAN

CONSTRUCTION INSPECTION PLAN: SATURATED BUFFER


The work shall be performed in accordance with the drawings and specifications unless otherwise approved, in writing, by the design engineer. For items of work requiring inspection, it is the responsibility of the contractor to keep the design engineer and the local NRCS office informed of the progress of work so that timely observation of critical construction elements may be performed. Work installed without observation of work items will not be certified as meeting NRCS standards.

Items of Work Requiring Inspection (see plans for details)

- Water Control Structure – plum, bedding, connections, plate elevation
- Dispersion Pipe – elevations, connections, grade changes
- Crossing Existing Tile – elevation, verify use of nonperforated tile, connections
- Seeding and Fertilizing for Protective Cover – submit tags to NRCS for records

Contractor is to provide as-built elevations per the diagram below. As-built elevation data is to be submitted to the landowner, NRCS, and design engineer for review. Landowner is responsible for completing and maintaining the Operation and Maintenance Plan per their NRCS contract using the copy provided with the design manual.

Construction Checkout and As-Built Elevations Diagram

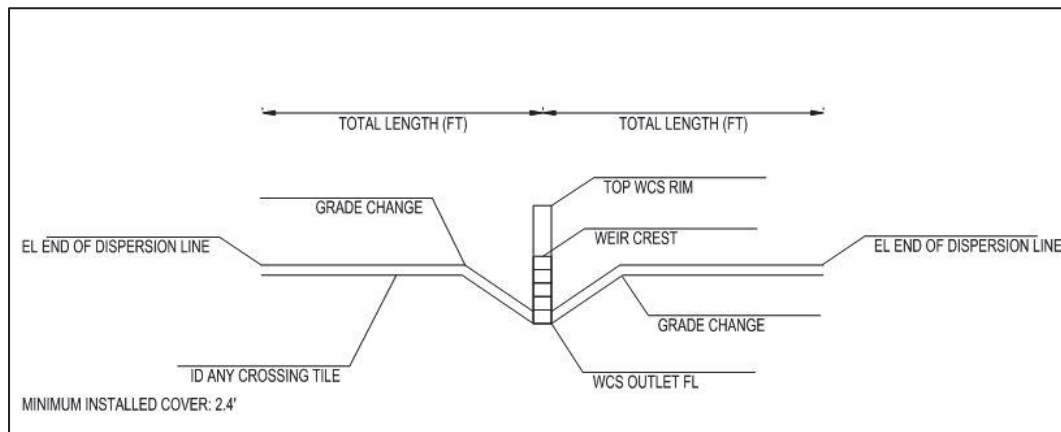

CONSTRUCTION INSPECTION PLAN: DENITRIFYING BIOREACTOR

The work shall be performed in accordance with the drawings and specifications unless otherwise approved, in writing, by design engineer. For items of work requiring inspection, it is the responsibility of the contractor to keep the design engineer and the local NRCS office informed of the progress of work so that timely observation of critical construction elements may be performed. Work installed without observation of required work items will not be certified as meeting NRCS standards.

Items of Work Requiring Inspection (see Plans for Details)

- Woodchips—source, quality, and gradation
- Excavation for Bioreactor—grade and elevations
- Liner installation—overlaps and installed condition
- Dual-wall HDPE (watertight)—joints
- Inlet & Outlet Water Control Structures—elevations, plum, bedding, connections and plates
- Washed Aggregate—sizing and gradation
- Dispersion & Collection Pipes—caps and rock bedding/envelope
- Seeding and Fertilizing for Protective Cover—submit fertilizer and seed tags to NRCS for record

Contractor is to provide as-built elevations per the diagram below. As-built elevation data is to be submitted to the landowner, NRCS, and design engineer for review. Landowner is responsible for completing and maintaining the Operation and Maintenance Plan per their contract using copy provided with design manual.

Construction Checkout and As-built Elevations Diagram

